
Generation and Reservoirs Statistics

September 24, 2020



PUBLIC UTILITIES COMMISSION OF SRI LANKA

Daily Generation Mix in MWh

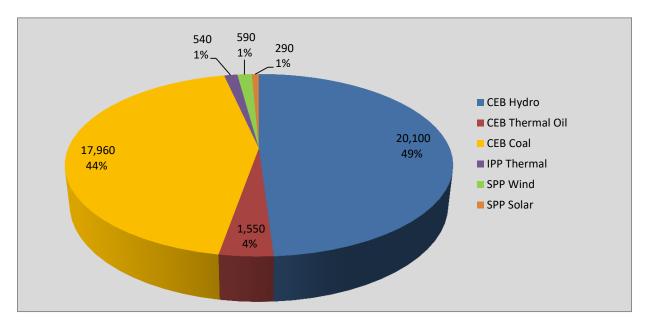

Total Generation

41,040 MWh

Note: Generation from other SPPs (Mini Hydro and Biomass) is not included

Cumulative Dispatch

Note: Generation from other SPPs (Mini Hydro, small scale Solar and Biomass) is not included

For Current Month


1 of Carrent Worth			
Category	Dispatch (GWh)		
CEB Hydro	342.9	36.26%	
CEB Thermal Oil	61.9	6.54%	
CEB Coal	413.4	43.72%	
IPP Thermal	93.2	9.86%	
SPP Wind	28.2	2.98%	
SPP Solar	6.0	0.64%	
Total	945.5		

For Current Year

Category	Dispatch (GWh)	
CEB Hydro	2,675.6	25.35%
CEB Thermal Oil	1,116.5	10.58%
CEB Coal	4,385.9	41.56%
IPP Thermal	2,056.8	19.49%
SPP Wind	244.3	2.31%
SPP Solar	74.4	0.70%
Total	10,553.4	

Thermal Plant Dispatch


September 24, 2020

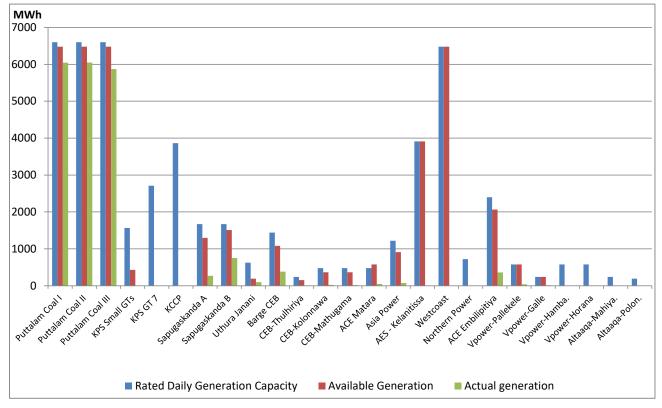

Available Generation is estimated based on plant availability at 6.00am on

September 25, 2020


Tharmal Plant Loading at the Night Peak

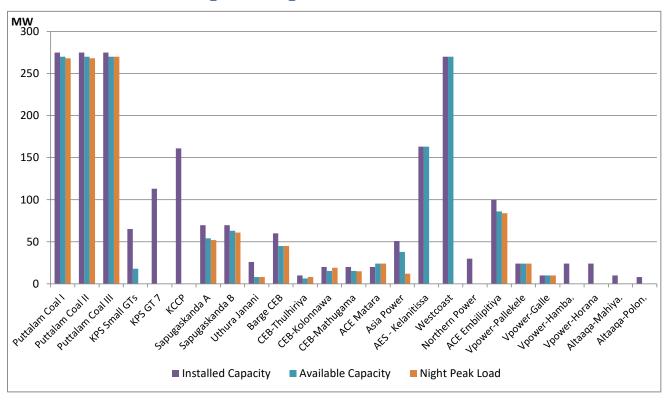

Note-Plant avilability is recorded at 6.00 am on September 25, 2020

Major Hydro Plant Dispatch

September 24, 2020

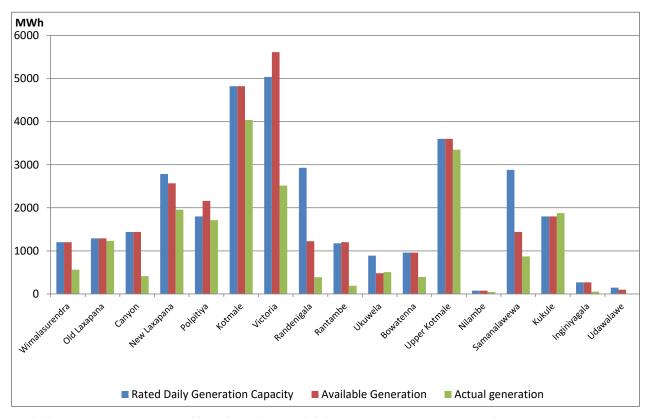


Note- Available Generation is estimated based on plant availability at 6.00am on

September 25, 2020

Major Hydro Plant Loading at Night Peak


September 24, 2020

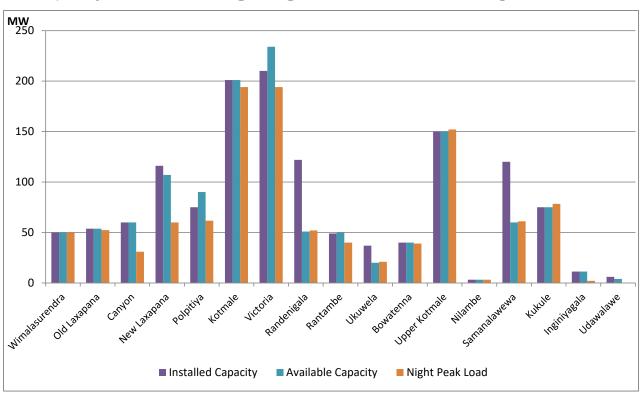

Note- Plant avilability is recorded at 6.00 am on September 25, 2020

Contribution to the Night Peak in MW


September 24, 2020

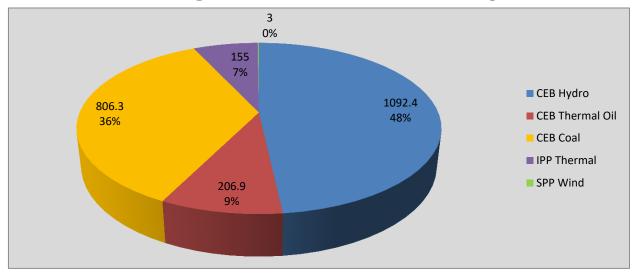

Night Peak*	2,263.6	MW
Day Peak	2,079.1	MW
Minimum Demand	1.233.8	MW

*The above chart pattern and night peak figure is presented excluding the contribution of Moragahakanda, other Notes: minihydro and biomass power plants from June 8 2020 onwards

Reservoir Levels - as at 06.00 Hr on September 25, 2020

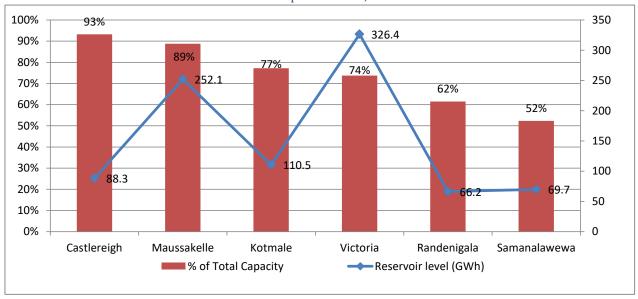


Total Reservoir Level(GWh) 913.2 % of Total capacity 75.8%

^{**}Day peak and Minimum demand includes the contribution from Moragahakanda, wind and solar plants


^{*} in addition to the night peak figure presented above, Moragahakanda plant, other MiniHydro and Biomass Plants of installed capacity 193.00 MW has recorded total 147.30 MW at night peak

Comparison of Total Reservoir Storage Levels with Past Years


Data from June 2018 to March 2020 are not indicated in the graph

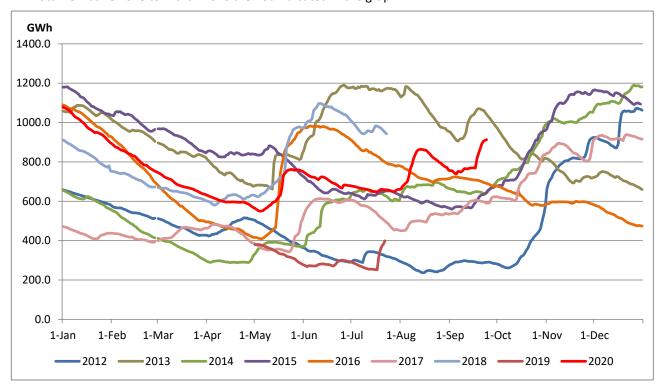

Variation of Major Hydro Reservoir Levels in the current year (GWh)

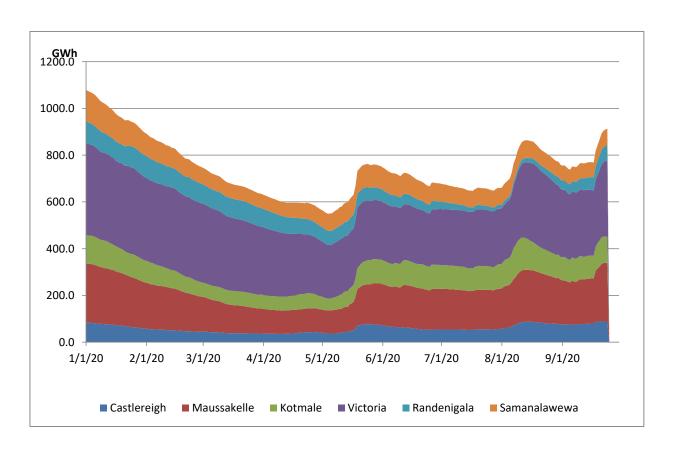

Variation of Demand during the current year

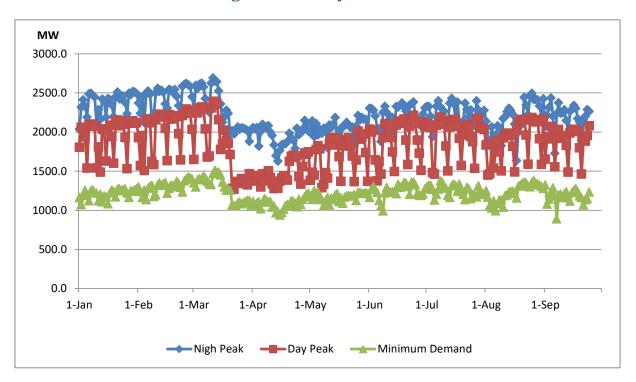


Notes: The night peak graph in the above chart is revised from June 8, 2020 to exclude the contribution from Minihydro and biomass power plants


Day peak and minimum demand graphs includes the contribution from Moragahakanda power plant All graphs include the contribution telemetered from solar and wind plants

Daily Load Curve of the Previous day

September 23, 2020


Solar and wind data is based on Telemetered Power Stations only

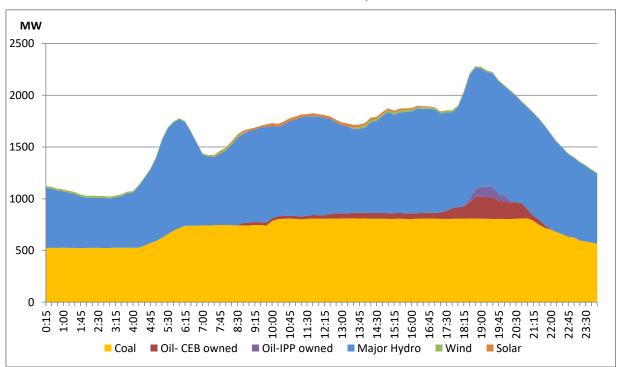

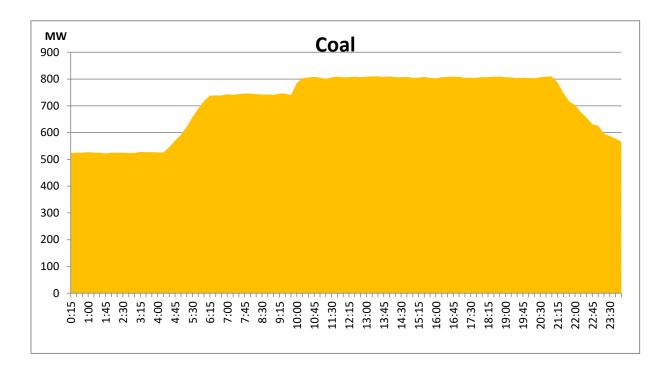


CEB Oil Plant Generation during the Previous day

September 23, 2020

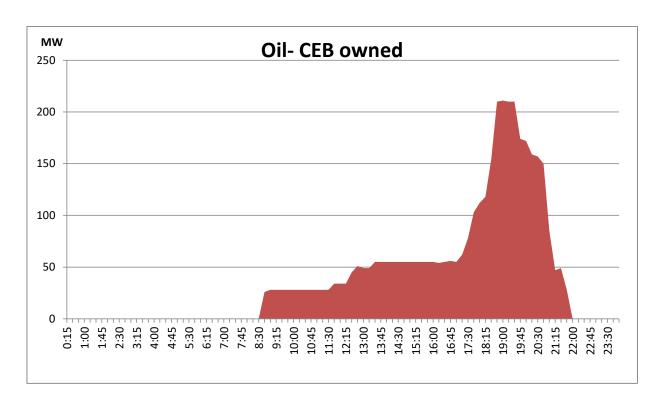


IPP Oil Plant Generation during the Previous day

September 23, 2020

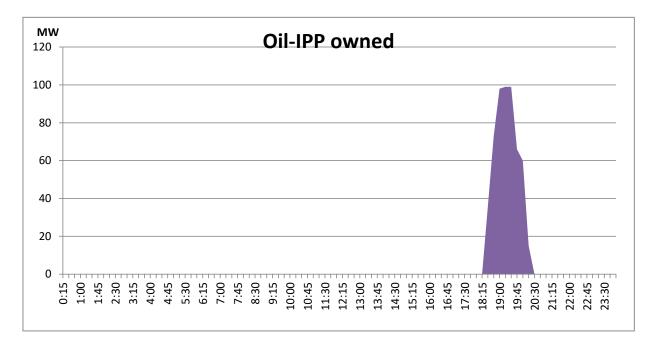


Major Hydro Generation during the Previous day

September 23, 2020

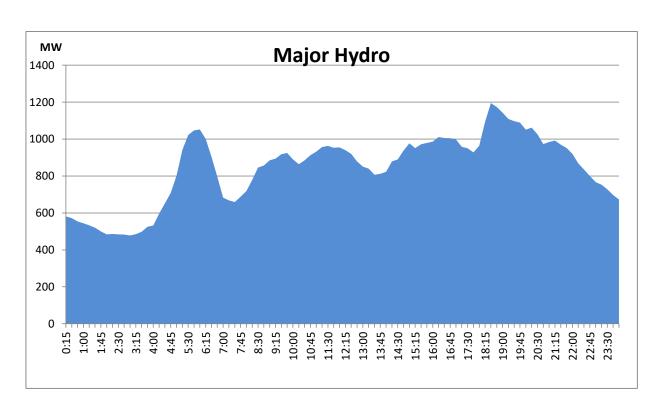


Based on Telemetered Power Stations only

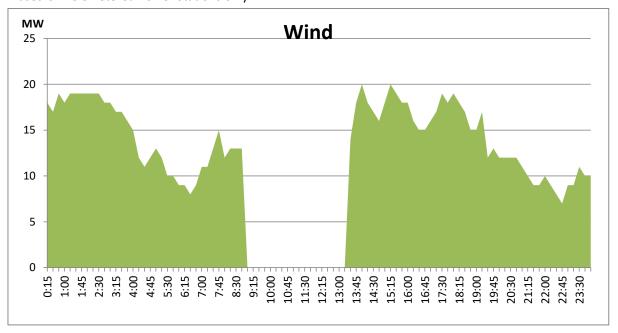

Solar Generation during the Previous day

September 23, 2020

Based on Telemetered Power Stations only

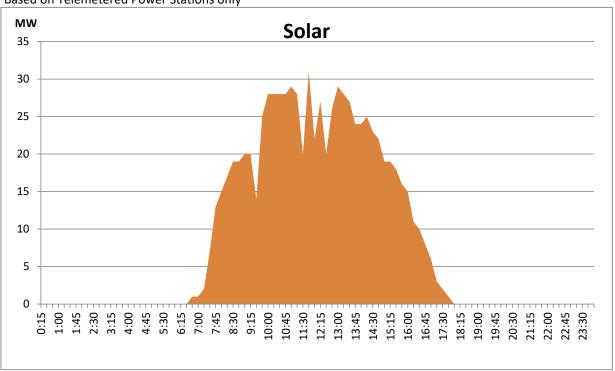

Plant	Installed Capacity	Plant Availability	Night peak Load	Plant Dispatch
	(MW)	(MW)	(MW)	(GWh)
Wimalasurendra	50.00	50.00	50.00	562.00
Old Laxapana	53.80	53.80	52.30	1,231.00
Canyon	60.00	60.00	31.00	413.00
New Laxapana	116.00	107.00	60.00	1,955.00
Polpitiya	75.00	90.00	61.70	1,713.00
Kotmale	201.00	201.00	194.00	4,040.00
Victoria	210.00	234.00	194.00	2,517.00
Randenigala	122.00	51.00	52.00	387.00
Rantambe	49.00	50.00	40.00	192.00
Ukuwela	37.00	20.00	21.00	505.00
Bowatenna	40.00	40.00	39.00	394.00
Upper Kotmale	150.00	150.00	152.00	3,350.00
Nilambe	3.20	3.20	3.20	46.00
Samanalawewa	120.00	60.00	61.00	870.00
Kukule	75.00	75.00	78.30	1,879.00
Inginiyagala	11.25	11.25	2.10	54.00
Udawalawe	6.00	4.00	-	-
Puttalam Coal I	275.00	270.00	268.00	6,044.00
Puttalam Coal II	275.00	270.00	268.00	6,047.00
Puttalam Coal III	275.00	270.00	270.00	5,873.00
KPS Small GTs	65.20	18.00	-	-
KPS GT 7	113.00	-	-	-
KCCP	161.00	-	-	-
Sapugaskanda A	69.60	54.00	52.00	272.00
Sapugaskanda B	69.60	63.00	61.00	751.00
Uthura Janani	26.01	8.00	8.00	97.00
Barge CEB	60.00	45.00	45.00	381.00
CEB-Thulhiriya	10.00	6.40	8.00	10.00
CEB-Kolonnawa	20.00	15.20	19.00	22.00
CEB-Mathugama	20.00	15.20	15.00	19.00
ACE Matara	20.00	24.00	24.00	49.00
Asia Power	50.80	38.00	12.00	73.00
AES - Kelanitissa	163.00	163.00	-	-
Westcoast	270.00	270.00	-	-
ACE Embilipitiya	100.00	86.00	84.00	360.00
Vpower-Pallekele	24.00	24.00	24.00	39.00
Vpower-Galle	10.00	10.00	10.00	16.00
Vpower-Hamba.	24.00	-	-	-
Vpower-Horana	24.00	-	-	-
Altaaqa-Mahiya.	10.00	-	-	-
Altaaqa-Polon.	8.00	-	-	-
Solar	58.00		-	294.00
Wind	128.00		3.00	586.00
MH and BM	394.00		147.00	Not available
Total without NCRE	3,522.46	2,910.05		

Night peak load of MH and BM only include loading of Minihydro plants of total capacity MW 193 Installed capacity of Solar, wind, Mini-hydro and Biomass plants are as of end of December 2019 Plant availability is the availability recorded at 6 am on September 25, 2020

Thermal Plant Fuel types

Power Station	Primary Fuel	
CEB Thermal		
Sapugaskanda 1	Heavy Fuel	
Sapugaskanda 2	Heavy Fuel	
Kelanitissa Small Gas	Auto Diesel	
Turbines	Auto Diesei	
GT 7 - Kelanitissa	Auto Diesel	
Kelanitissa CCY	Naptha & Diesel	
Lakvijaya 1	Coal	
Lakvijaya 2	Coal	
Lakvijaya 3	Coal	
Uthuru Janani	Heavy Fuel	
Barge CEB	Furnace Oil	

Power Station	Primary Fuel
Private Thermal	
Asia Power	Heavy Fuel
Sojitz -	Auto Diesel
West Coast	Low Sulphur
	Furnace oil
ACE Embilipitiya	Furnace Oil

Major Incidents during the day -as reported by CEB morning of

September 25, 2020

- 1) Norton pond spilling started at 7:02 hrs and stopped at 21:42 hrs.
- 2) Laxapana pond spilling started at 8:55 hrs and stopped at 16:28 hrs.
- 3) Mahiyangana-Rantambe cct 01 switched off at 16:34 hrs due to fault in main protection relay at Mahiyanagana end.

The cct was unable to switch on after backup protection setting modification due to failure in remote operation of the bay controller at Mahiyangana end.