


Generation and Reservoirs Statistics

January 19, 2022



PUBLIC UTILITIES COMMISSION OF SRI LANKA

Daily Generation Mix in MWh

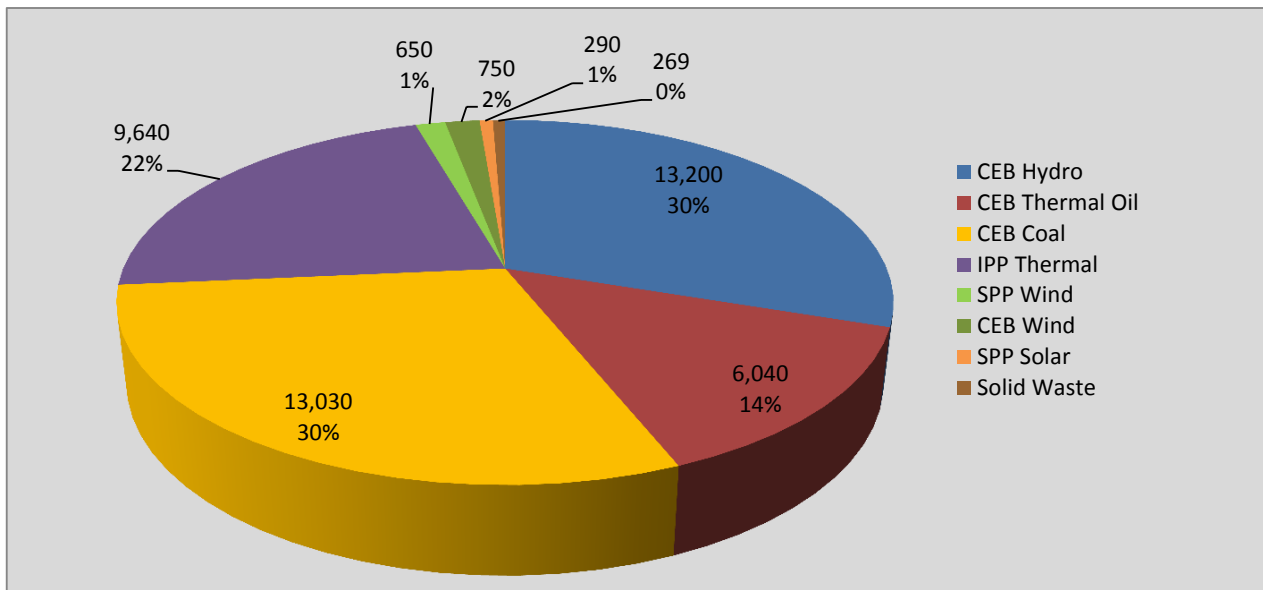

Total Generation **43,872 MWh**

Note: Above data is Excluding contribution from Roof Top Solar, 1MW solar and Mini Hydro plants

Cumulative Dispatch

Note: Following data is Excluding contribution from Roof Top Solar, 1MW solar and Mini Hydro plants

For Current Month


Category	Dispatch (GWh)	Percentage
CEB Hydro	262.4	33.13%
CEB Thermal Oil	133.1	16.80%
CEB Coal	246.7	31.14%
IPP Thermal	115.7	14.60%
SPP Wind	11.2	1.42%
CEB Wind	13.5	1.71%
SPP Solar	4.7	0.59%
SPP Solid Waste	4.9	0.62%
Total	792.2	

For Current Year

Category	Dispatch (GWh)	Percentage
CEB Hydro	262.4	33.13%
CEB Thermal Oil	133.1	16.80%
CEB Coal	246.7	31.14%
IPP Thermal	115.7	14.60%
SPP Wind	11.2	1.42%
CEB Wind	13.5	1.71%
SPP Solar	4.7	0.59%
SPP Waste Heat	4.9	0.62%
Total	792.2	

CEB owned Thermal Plant Dispatch


January 19, 2022

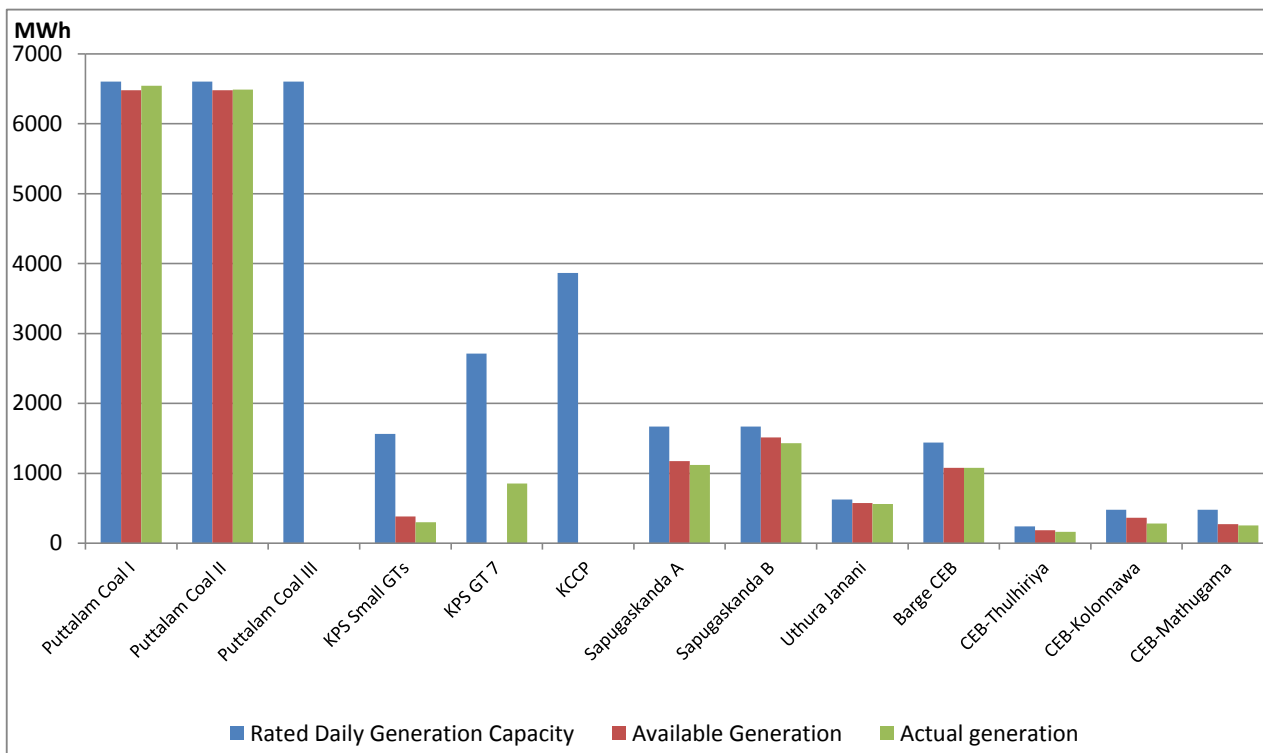

Available Generation is estimated based on plant availability at 6.00am on

January 20, 2022

CEB owned Thermal Plant Loading at the Night Peak

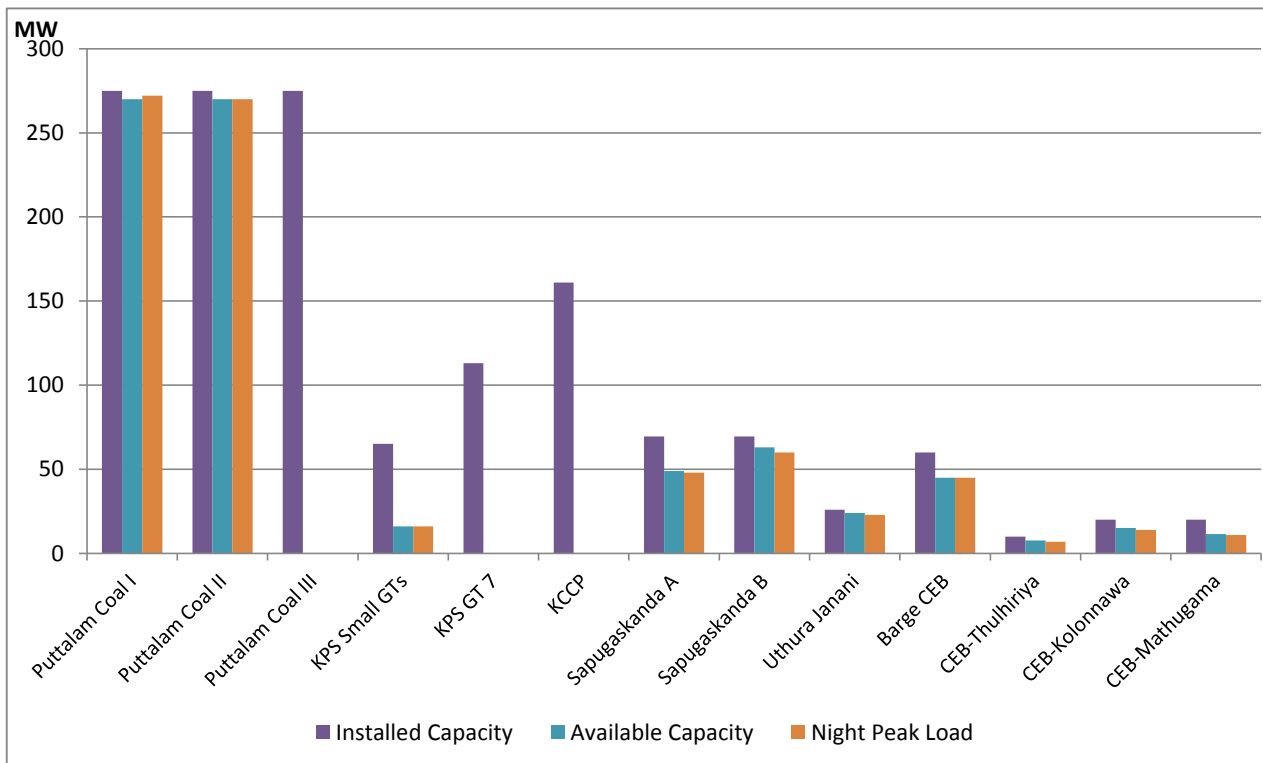


Note- Plant availability is recorded at 6.00 am on

January 20, 2022

IPP owned Thermal Plant Dispatch

January 19, 2022


ACE Embilipitiya, ACE Matara, Asia Power, V Power Pallekale, Vpower Galle, V Power Horana, Vpower Hambantota, Vpower Valachchena and Altaqa Mahiyanganaya are not available due to expiration of PPAs

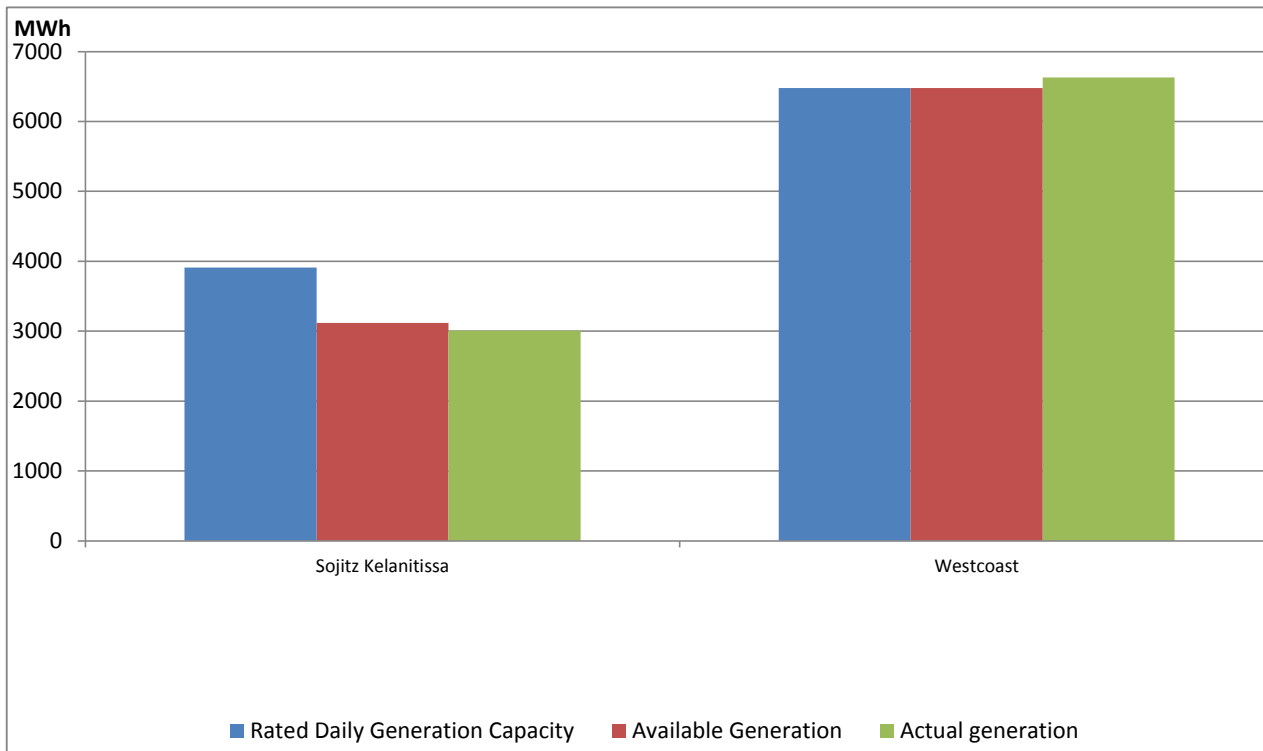

Available Generation is estimated based on plant availability at 6.00am on

January 20, 2022

IPP owned Thermal Plant Loading at the Night Peak

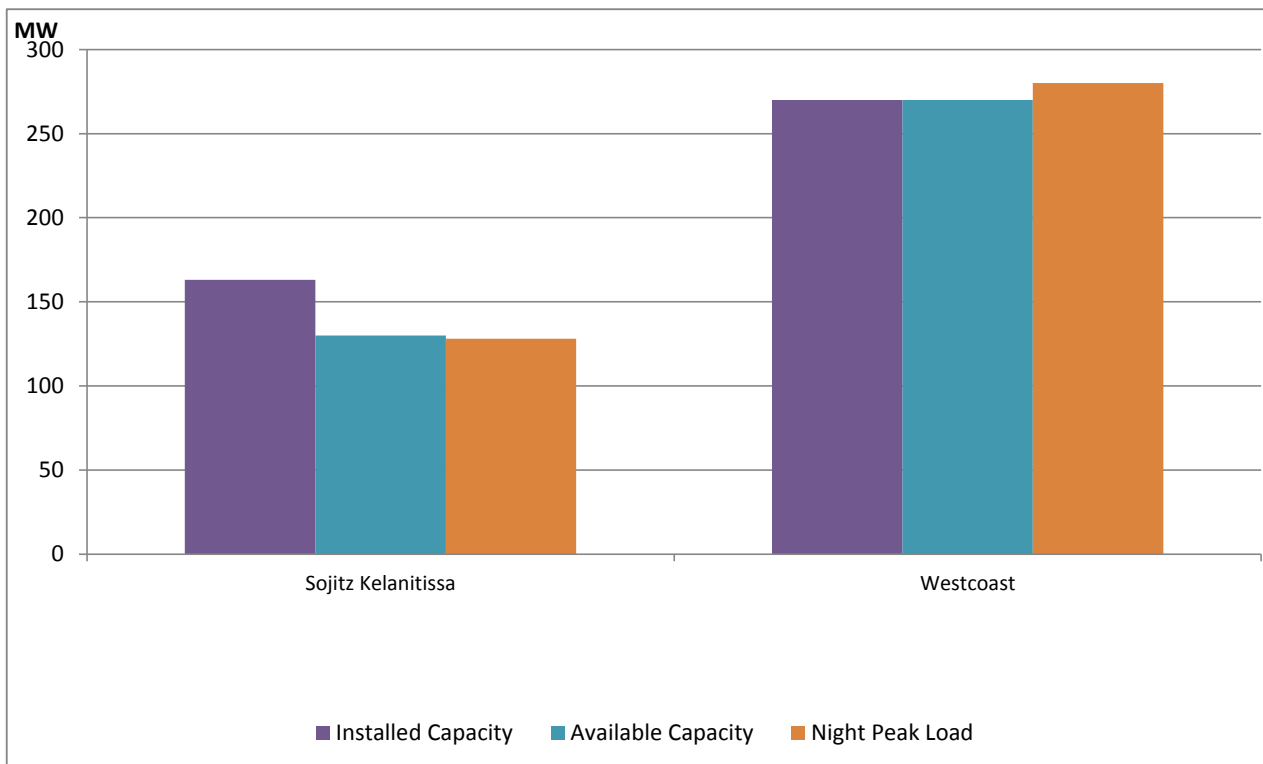


Note- Plant availability is recorded at 6.00 am on

January 20, 2022

Major Hydro Plant Dispatch


January 19, 2022

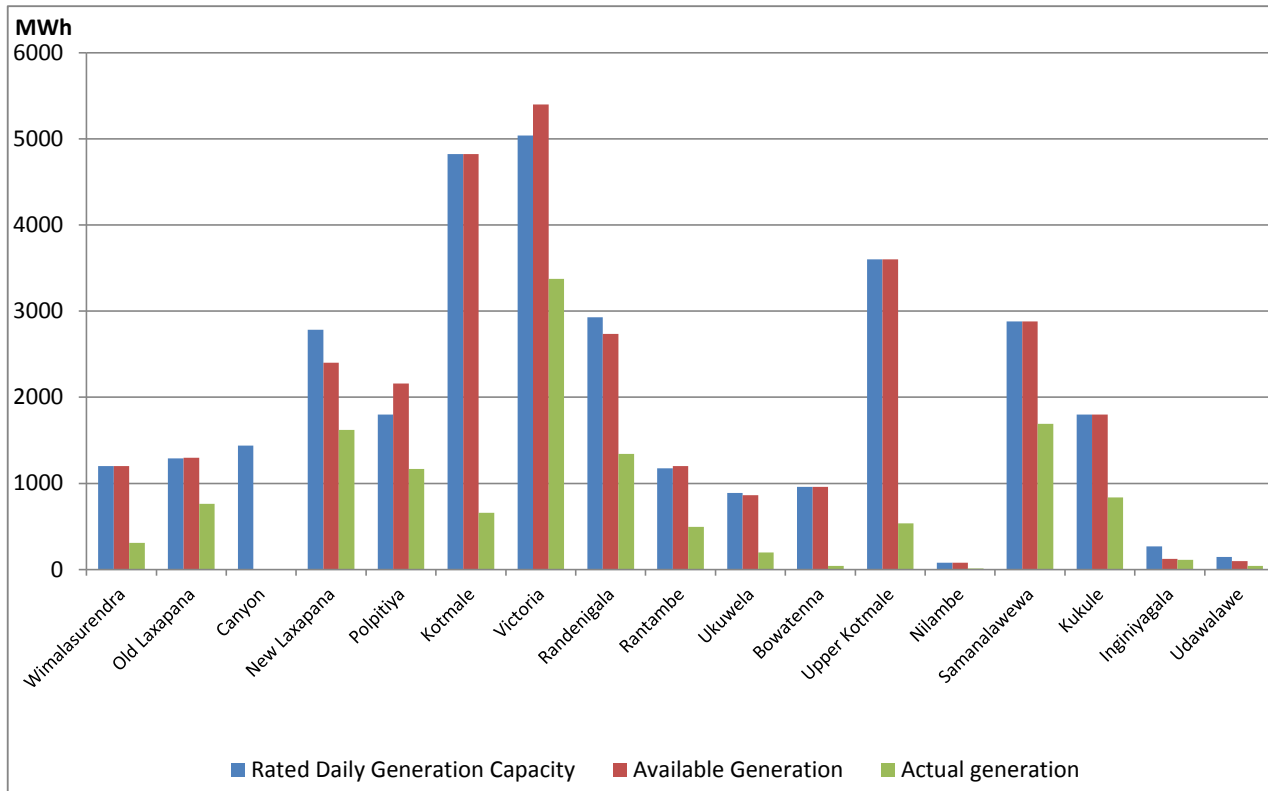

Note- Available Generation is estimated based on plant availability at 6.00am on January 20, 2022

Major Hydro Plant Loading at Night Peak

January 19, 2022

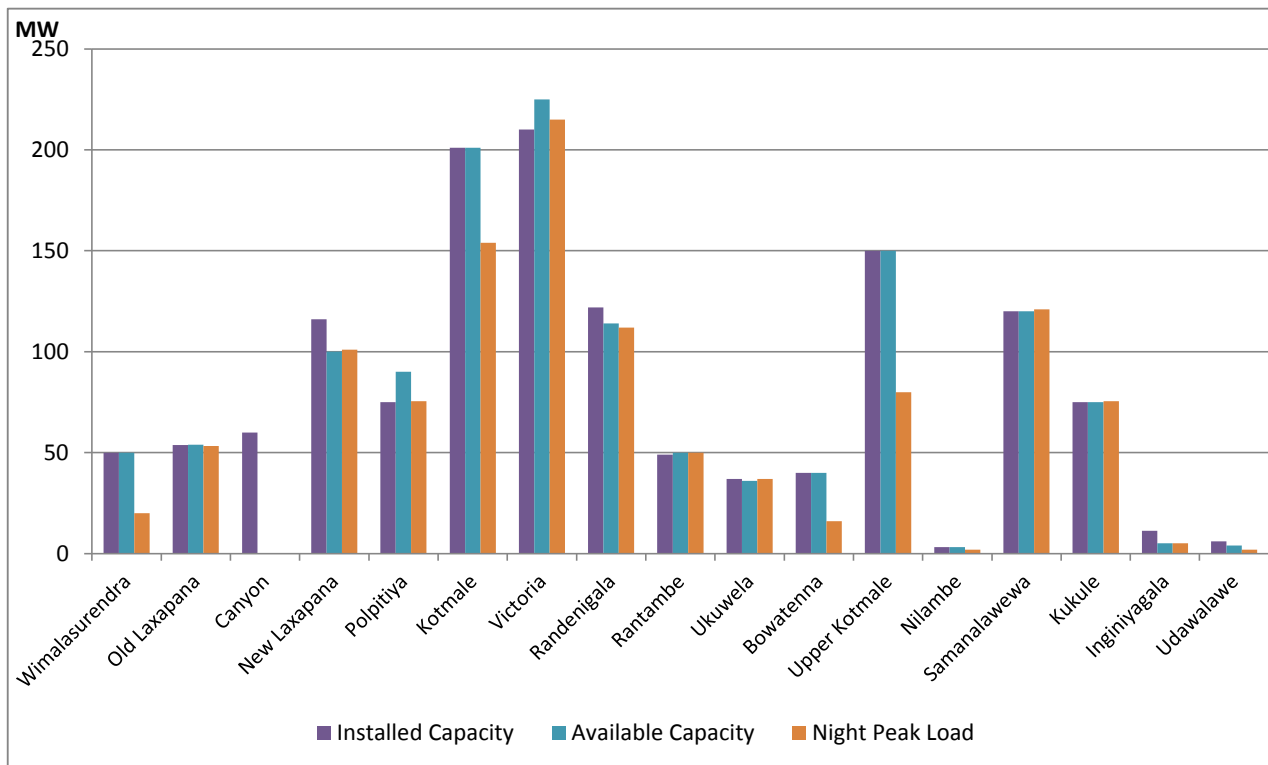

Note- Plant availability is recorded at 6.00 am on January 20, 2022

Summary of Major Plant performance

Plant	Installed Capacity (MW)	Plant Availability (MW)	Night peak Load (MW)	Dispatch (GWh)
Wimalasurendra	50.00	50.00	20.00	310.00
Old Laxapana	53.80	54.00	53.30	763.00
Canyon	60.00	-	-	-
New Laxapana	116.00	100.00	101.00	1,622.00
Polpitiya	75.00	90.00	75.50	1,166.00
Kotmale	201.00	201.00	154.00	660.00
Victoria	210.00	225.00	215.00	3,373.00
Randenigala	122.00	114.00	112.00	1,342.00
Rantambe	49.00	50.00	50.00	496.00
Ukuwela	37.00	36.00	37.00	198.00
Bowatenna	40.00	40.00	16.00	40.00
Upper Kotmale	150.00	150.00	80.00	535.00
Nilambe	3.20	3.20	2.00	12.00
Samanalawewa	120.00	120.00	121.00	1,691.00
Kukule	75.00	75.00	75.50	837.00
Inginiyagala	11.25	5.10	5.10	112.00
Udawalawe	6.00	4.00	2.00	43.00
Puttalam Coal I	275.00	270.00	272.00	6,544.00
Puttalam Coal II	275.00	270.00	270.00	6,488.00
Puttalam Coal III	275.00	-	-	-
KPS Small GTs	65.20	16.00	16.00	302.00
KPS GT 7	113.00	-	-	854.00
KCCP	161.00	-	-	-
Sapugaskanda A	69.60	49.00	48.00	1,121.00
Sapugaskanda B	69.60	63.00	60.00	1,430.00
Uthura Janani	26.01	24.00	23.00	562.00
Barge CEB	60.00	45.00	45.00	1,080.00
CEB-Thulhiriya	10.00	7.70	7.00	163.00
CEB-Kolonnawa	20.00	15.20	14.00	280.00
CEB-Mathugama	20.00	11.40	11.00	253.00
Sojitz Kelanitissa	163.00	130.00	128.00	3,010.00
Westcoast	270.00	270.00	280.00	6,630.00
Vpower-Valach.	24.00	-	-	-
Solar	68.00		-	285.00
Wind	248.00		42.80	1,396.00
MH and BM	441.00		33.50	Not available
Total without NCRE	3,538.46	2,488.60		

Night peak load of MH and BM only include loading of Mini hydro plants of total capacity MW

129


Installed capacity of Solar, wind, Mini-hydro and Biomass plants are as of end of December 2019

Plant availability is the availability recorded at 6 am on

January 20, 2022

Contribution to the Night Peak in MW

January 19, 2022

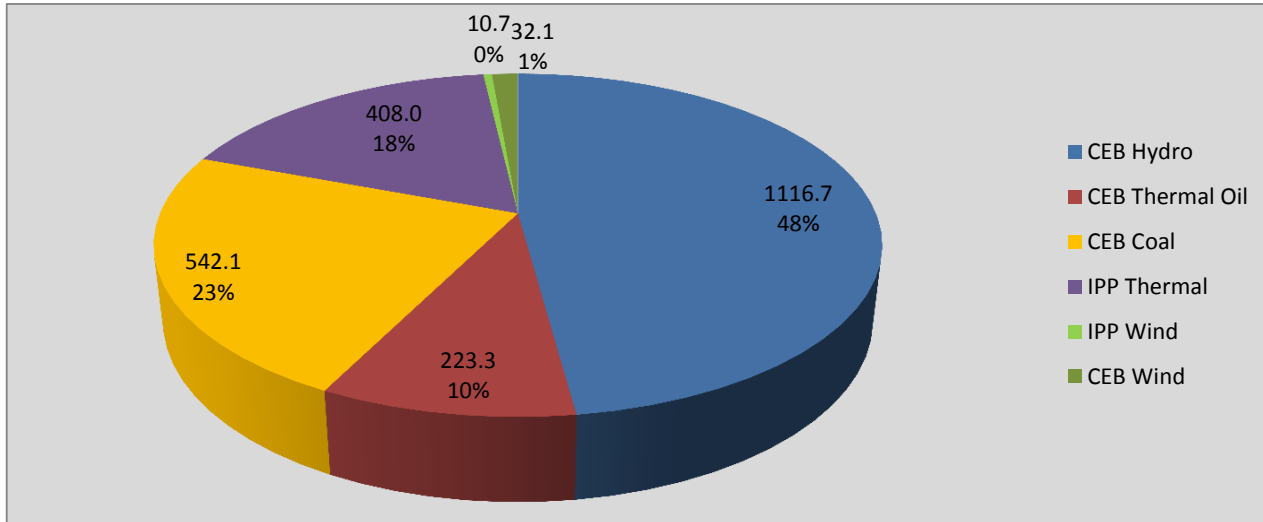


Night Peak*	2,332.9 MW
Day Peak	2,037.8 MW
Minimum Demand	1,371.4 MW

Above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants


* in addition to the night peak figure presented above, Kerawalapitiya solid waste plant and 26 no. of MiniHydro Plants has contributed 44.40 MW to the night peak

Reservoir Levels - as at 06.00 Hr on January 20, 2022

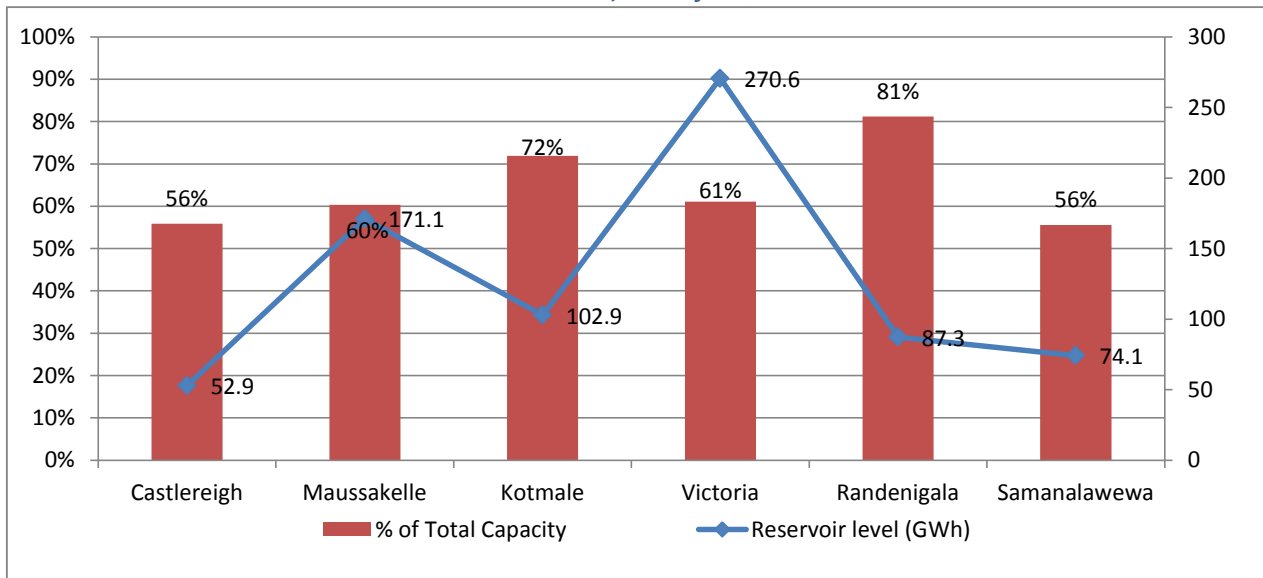


Total Reservoir Level(GWh)	758.9
% of Total capacity	63.0%

Comparison of Total Reservoir Storage Levels with Past Years

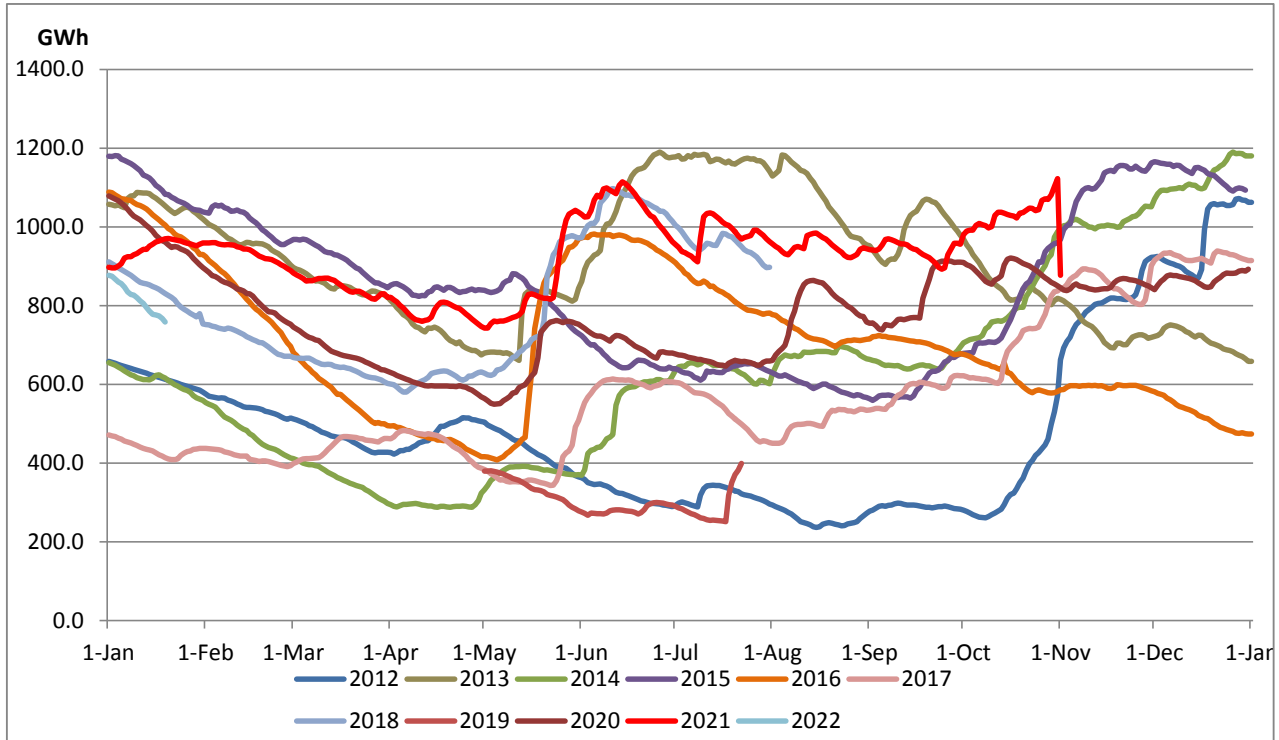


Data for 2018 and 2019 are only available for part of year.

Variation of Major Hydro Reservoir Levels in the current year (GWh)

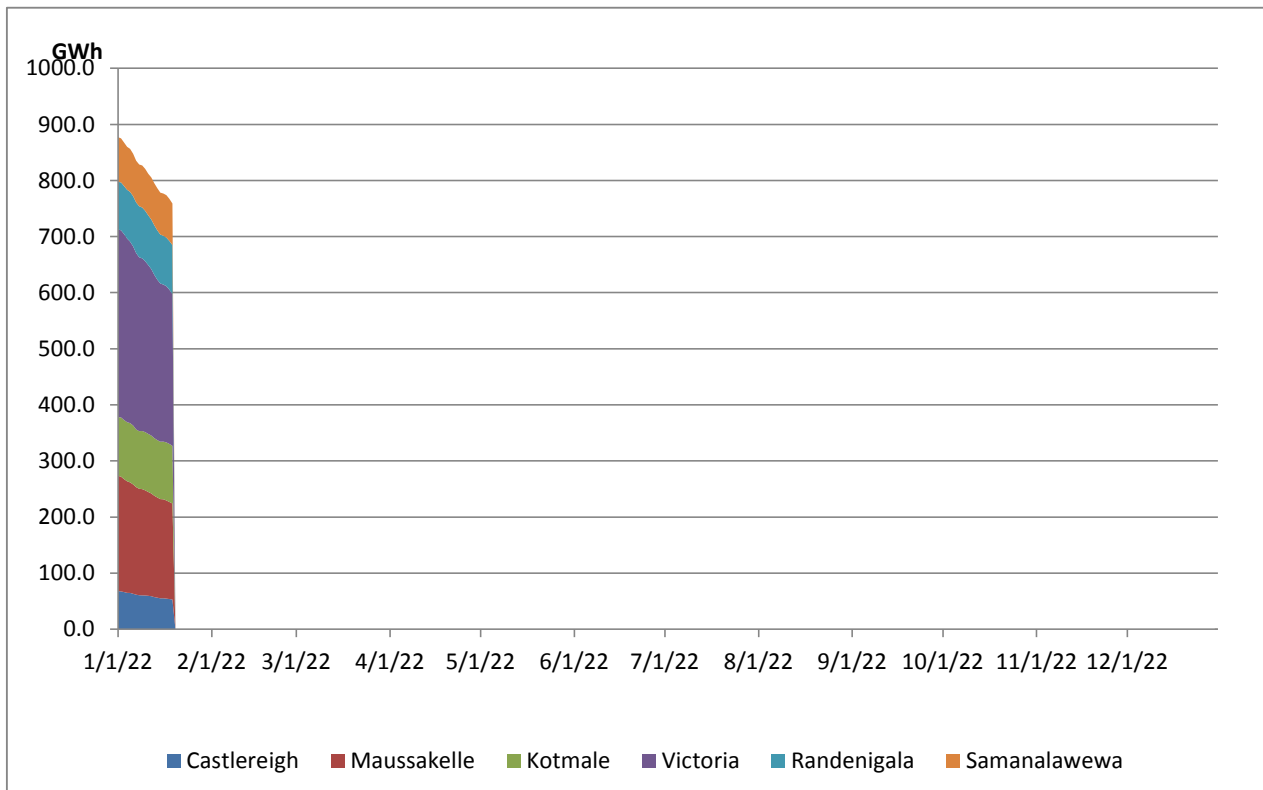

Variation of Demand during the current year

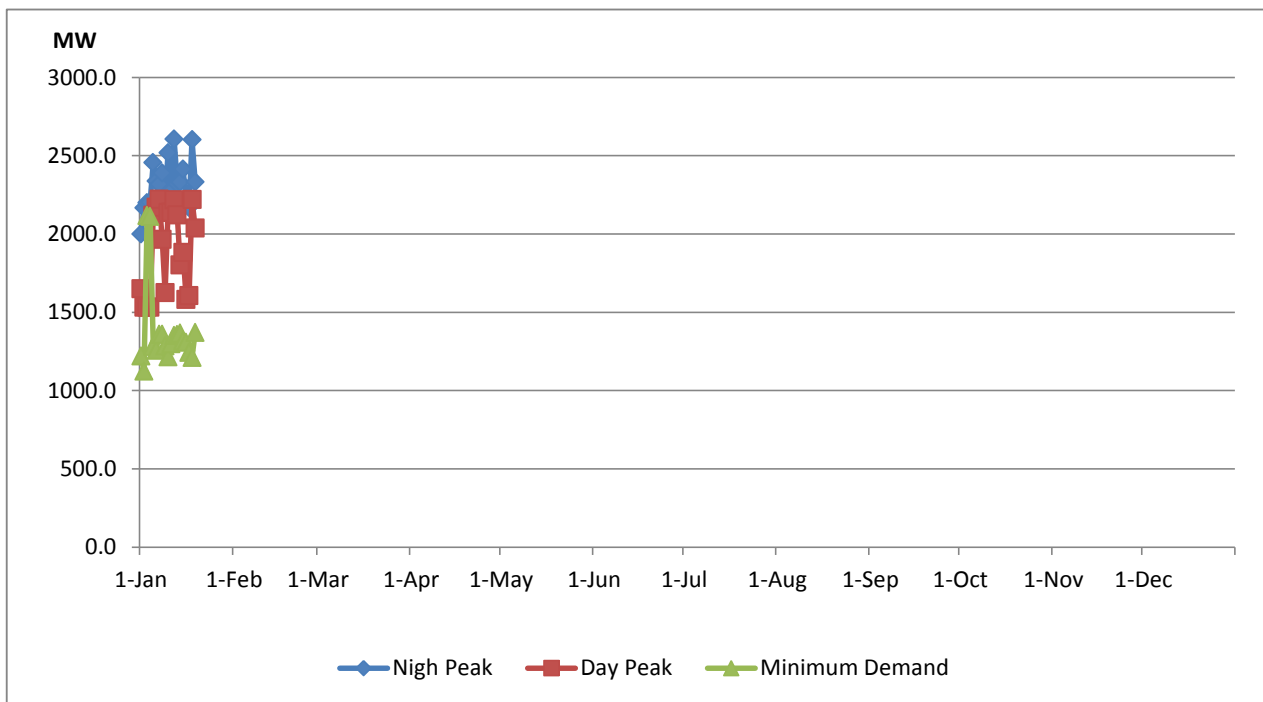


as: The above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants

Daily Load Curve of the Previous day


January 18, 2022

Solar and wind data is based on Telemetered Power Stations only

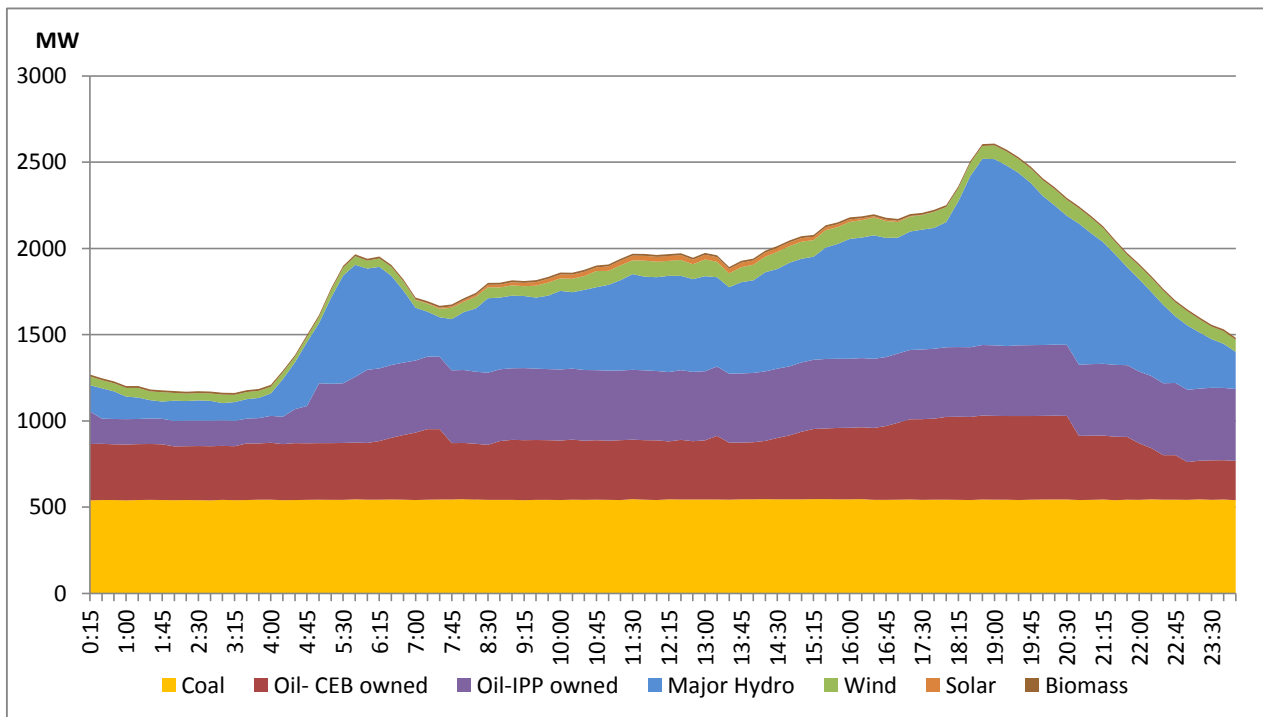


Coal Generation during the Previous day

January 18, 2022

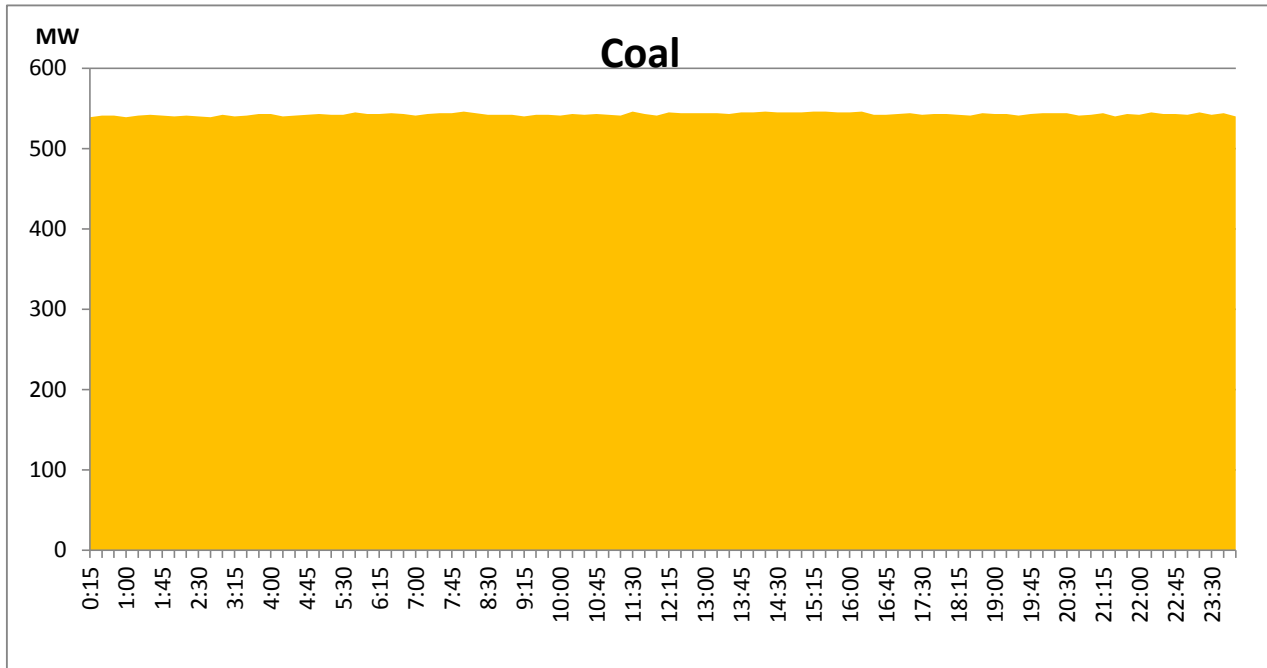


CEB Oil Plant Generation during the Previous day

January 18, 2022

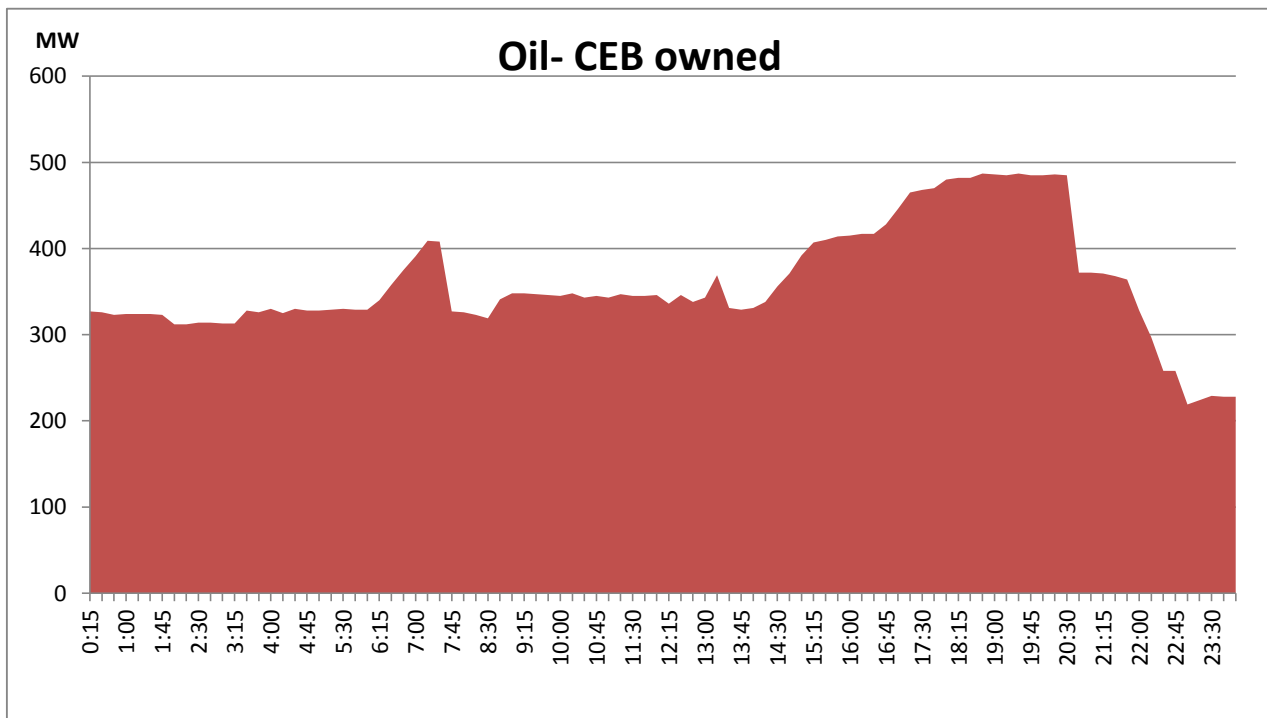


IPP Oil Plant Generation during the Previous day

January 18, 2022

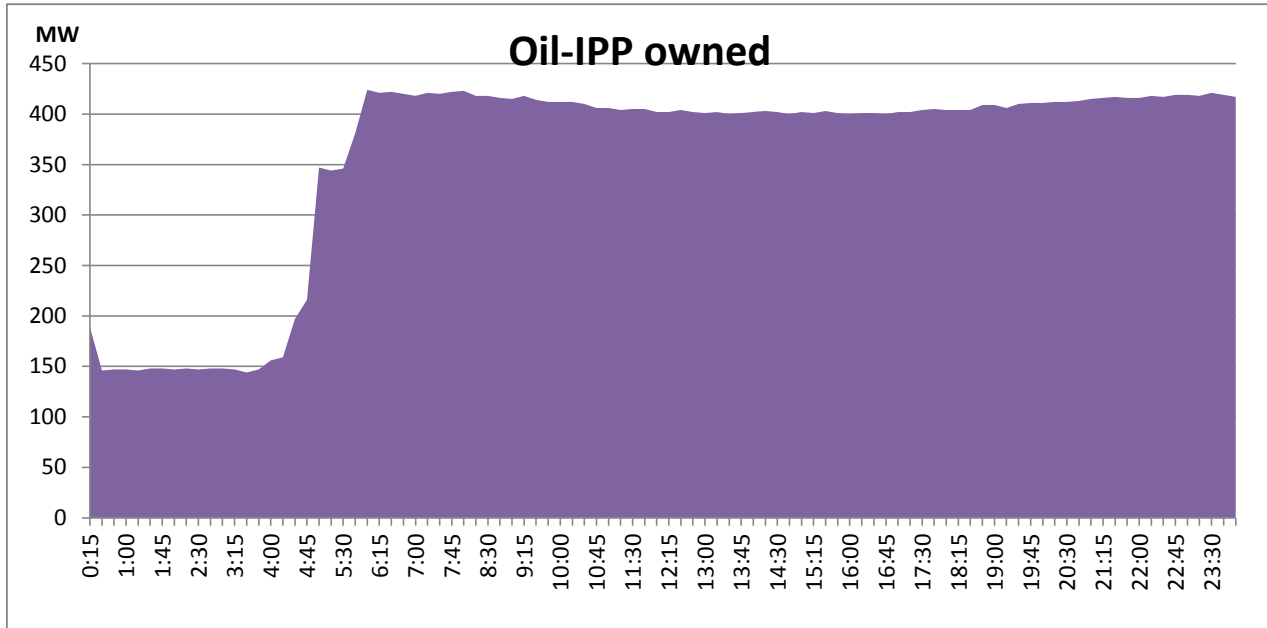

Major Hydro Generation during the Previous day


January 18, 2022

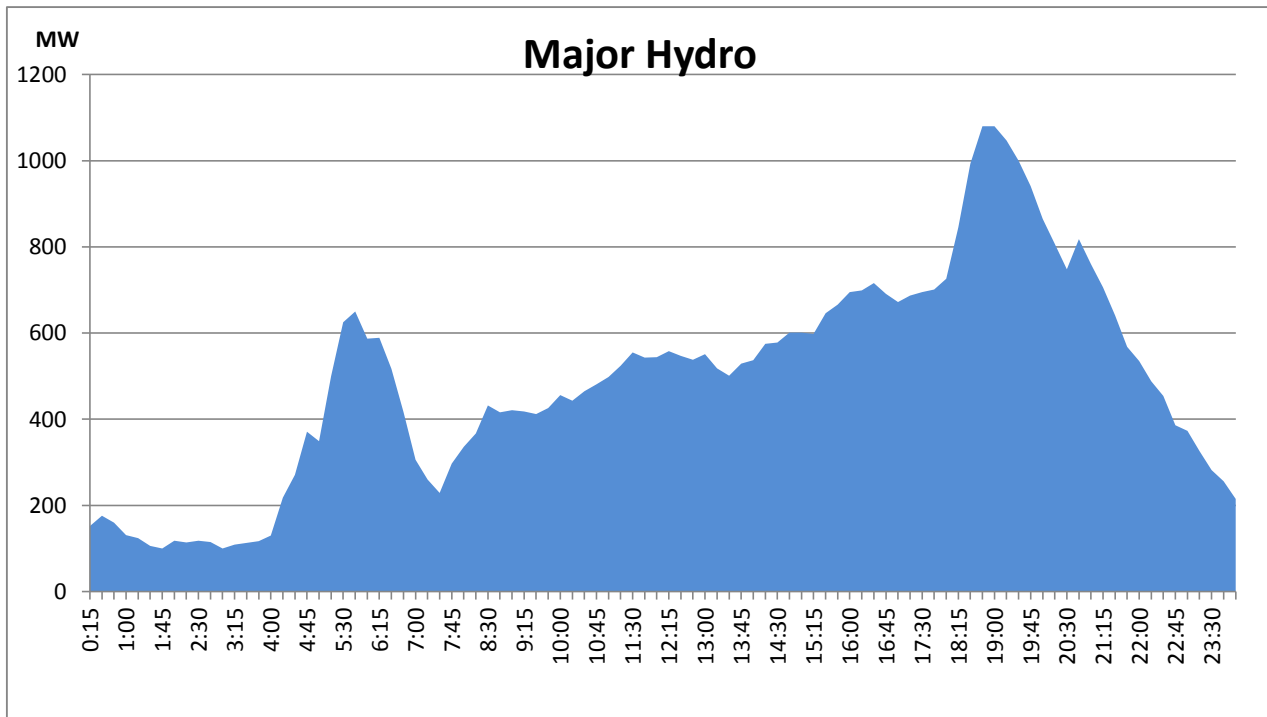

Wind Generation during the Previous day

January 18, 2022


Based on Telemetered Power Stations only

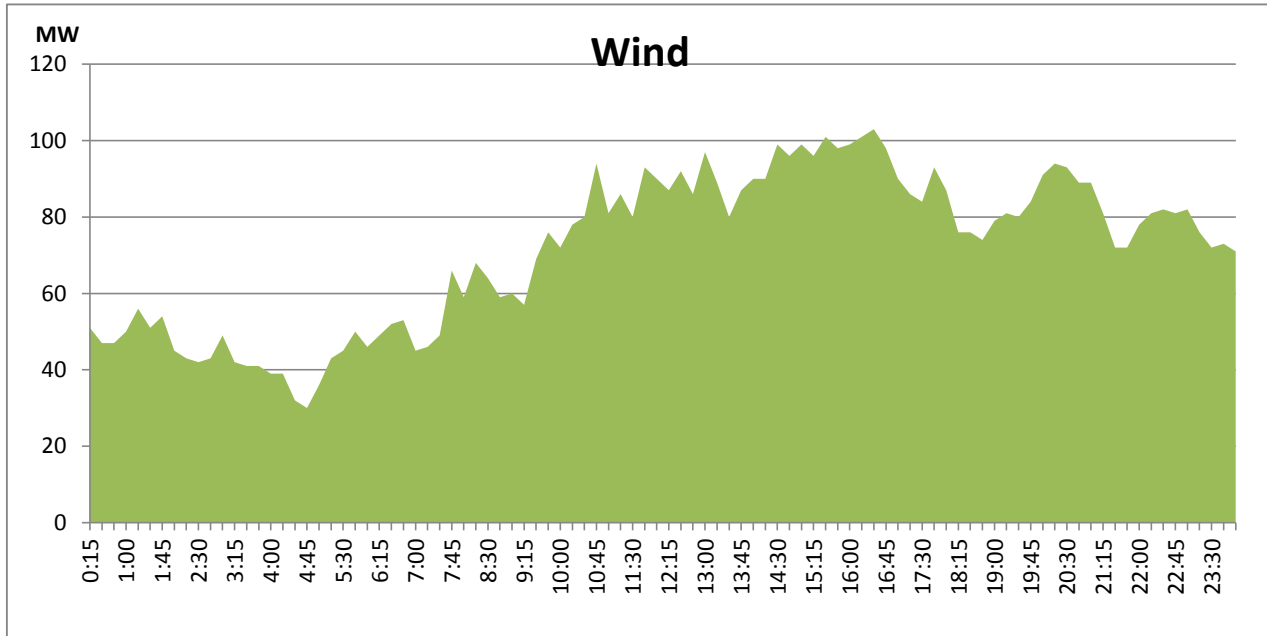

Solar Generation during the Previous day

January 18, 2022

Based on Telemetered Power Stations only

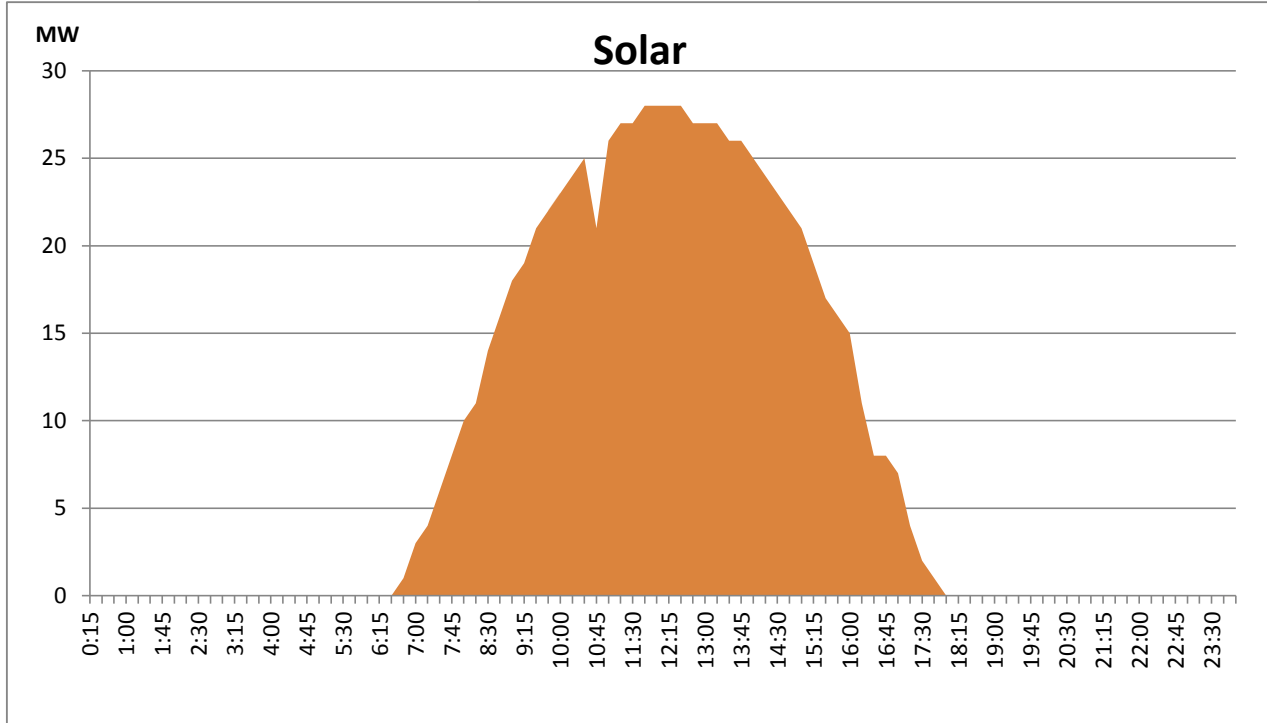

Thermal Plant Fuel types

Power Station	Primary Fuel
CEB Thermal	
Sapugaskanda 1	Heavy Fuel
Sapugaskanda 2	Heavy Fuel
Kelanitissa Small Gas Turbines	Auto Diesel
GT 7 - Kelanitissa	Auto Diesel
Kelanitissa CCY	Naptha & Diesel
Lakvijaya 1	Coal
Lakvijaya 2	Coal
Lakvijaya 3	Coal
Uthuru Janani	Heavy Fuel
Barge CEB	Furnace Oil

Power Station	Primary Fuel
Private Thermal	
Sojitz - Kelanitissa	Auto Diesel
West Coast	Low Sulphur Furnace oil

Major Incidents during the day -as reported by CEB morning of

January 20, 2022

- 1) GT 7 stopped at 13:10hrs due to lack of fuel stock. GT 07 is yet to resume generation.
- 2) Rotational Manual Load shedding was carried out from 14:30hrs to 21:30hrs due to inadequate generation.
- 3) Rantambe - Randenigala 220kV cct tripped from Randenigala end at 22:20hrs due to O/C, E/F trip. At the same time Rantambe unit 01 and Rantambe both 220/132kV T/Fs tripped causing Rantambe, Badulla, N'Eliya, Mahiyanganaya, Vavnavu, Ampara, Monaragala GSS to be dead. Rantambe, Badulla, N'Eliya, Mahiyanganaya, Vavnavu, Ampara, Monaragala GSS energized at 22:28hrs via O'Lax. Rantambe T/F 01 and T/F 02 energized at 00:05hrs(20/01/2022) and 00:07hrs(20/01/2022), respectively. Rantambe - Randenigala cct restored at 00:13hrs(20/01/2022). Rantambe unit 01 made available at 23:00hrs.