


Generation and Reservoirs Statistics

February 3, 2022



PUBLIC UTILITIES COMMISSION OF SRI LANKA

Daily Generation Mix in MWh

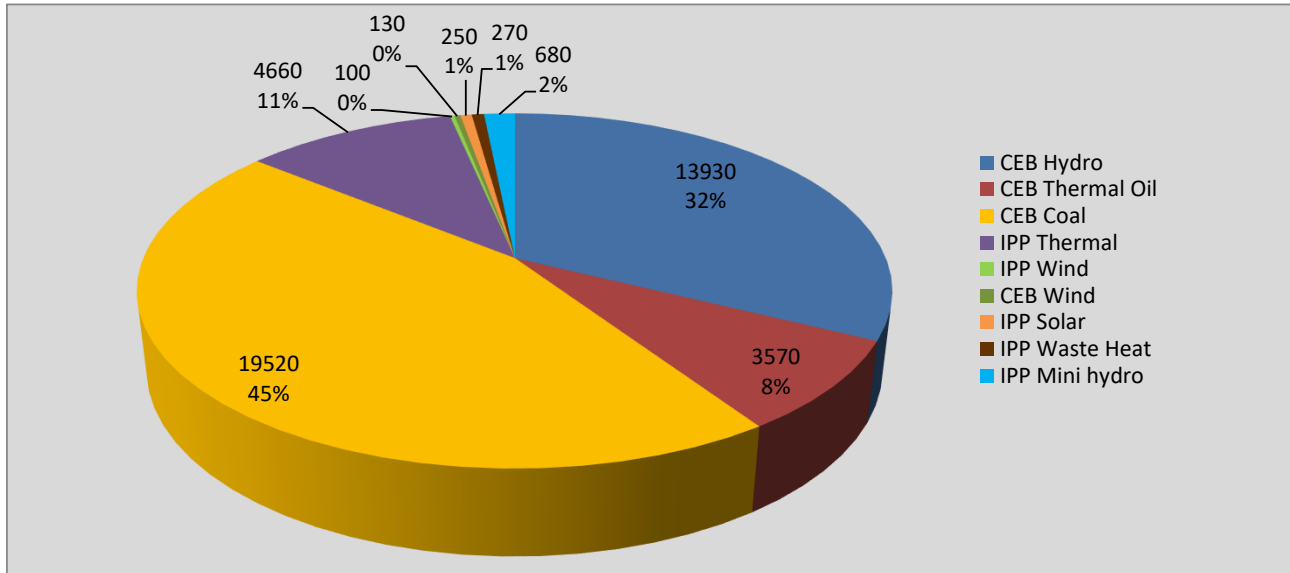

Total Generation 43,110 MWh

Note: Above data is excluding contribution from Roof Top Solar, 1MW Solar and certain Mini Hydro plants

Cumulative Dispatch

Note: Following data is Excluding contribution from Roof Top Solar, 1MW solar and Mini Hydro plants

For Current Month


Category	Dispatch (GWh)	Percentage
CEB Hydro	39.6	29.34%
CEB Thermal Oil	22.4	16.63%
CEB Coal	49.3	36.56%
IPP Thermal	17.6	13.08%
SPP Wind	1.0	0.71%
CEB Wind	1.1	0.82%
SPP Solar	0.9	0.66%
SPP Solid Waste	0.8	0.60%
Mini Hydro	2.2	1.60%
Total	134.8	

For Current Year

Category	Dispatch (GWh)	Percentage
CEB Hydro	446.8	30.30%
CEB Thermal Oil	266.5	18.07%
CEB Coal	456.5	30.95%
IPP Thermal	221.7	15.03%
SPP Wind	16.3	1.10%
CEB Wind	19.2	1.30%
SPP Solar	8.8	0.60%
SPP Solid Waste	9.0	0.61%
Mini Hydro	30.4	2.06%
Total	1,475.0	

CEB owned Thermal Plant Dispatch


February 3, 2022

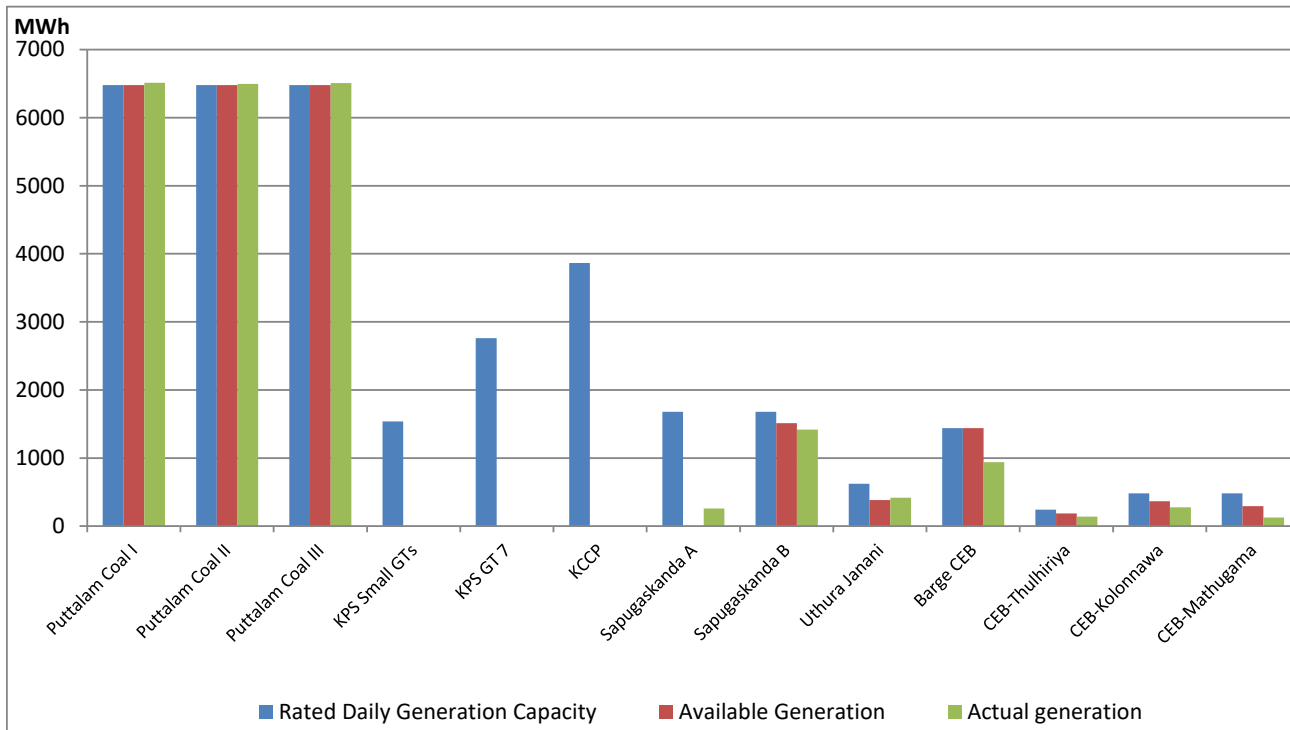

Available Generation is estimated based on plant availability at 6.00am on

February 4, 2022

CEB owned Thermal Plant Loading at the Night Peak

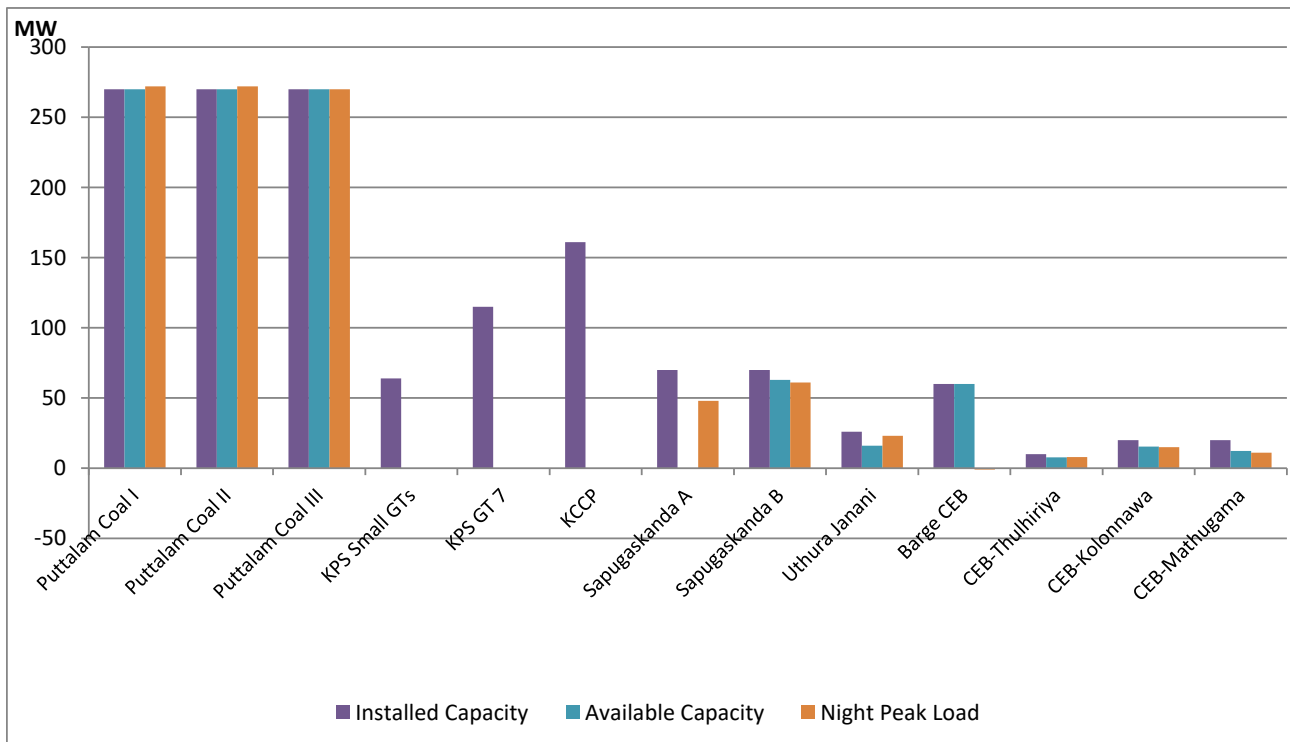


Note- Plant availability is recorded at 6.00 am on

February 4, 2022

IPP owned Thermal Plant Dispatch

February 3, 2022


ACE Embilipitiya, ACE Matara, Asia Power, V Power Pallekale, Vpower Galle, V Power Horana, Vpower Hambantota, Vpower Valachchena and Altaqa Mahiyanganaya are not available due to expiration of PPAs

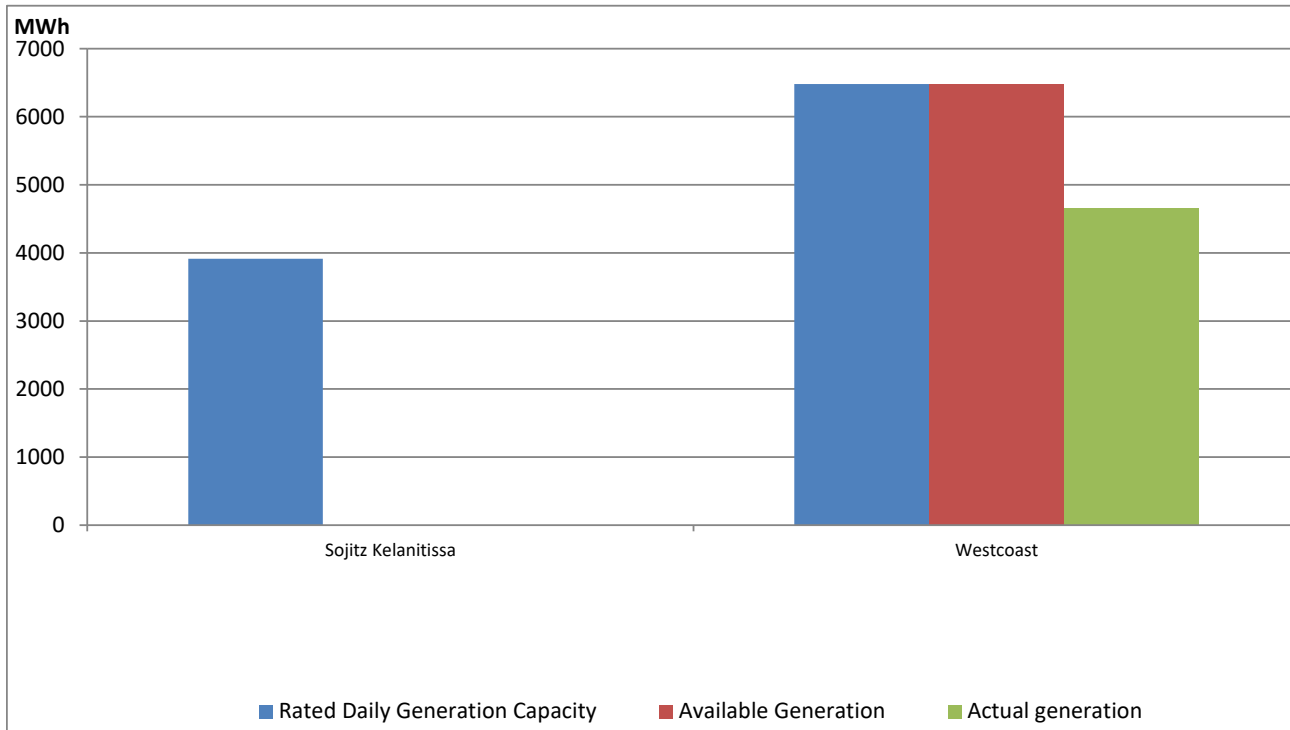

Available Generation is estimated based on plant availability at 6.00am on

February 4, 2022

IPP owned Thermal Plant Loading at the Night Peak

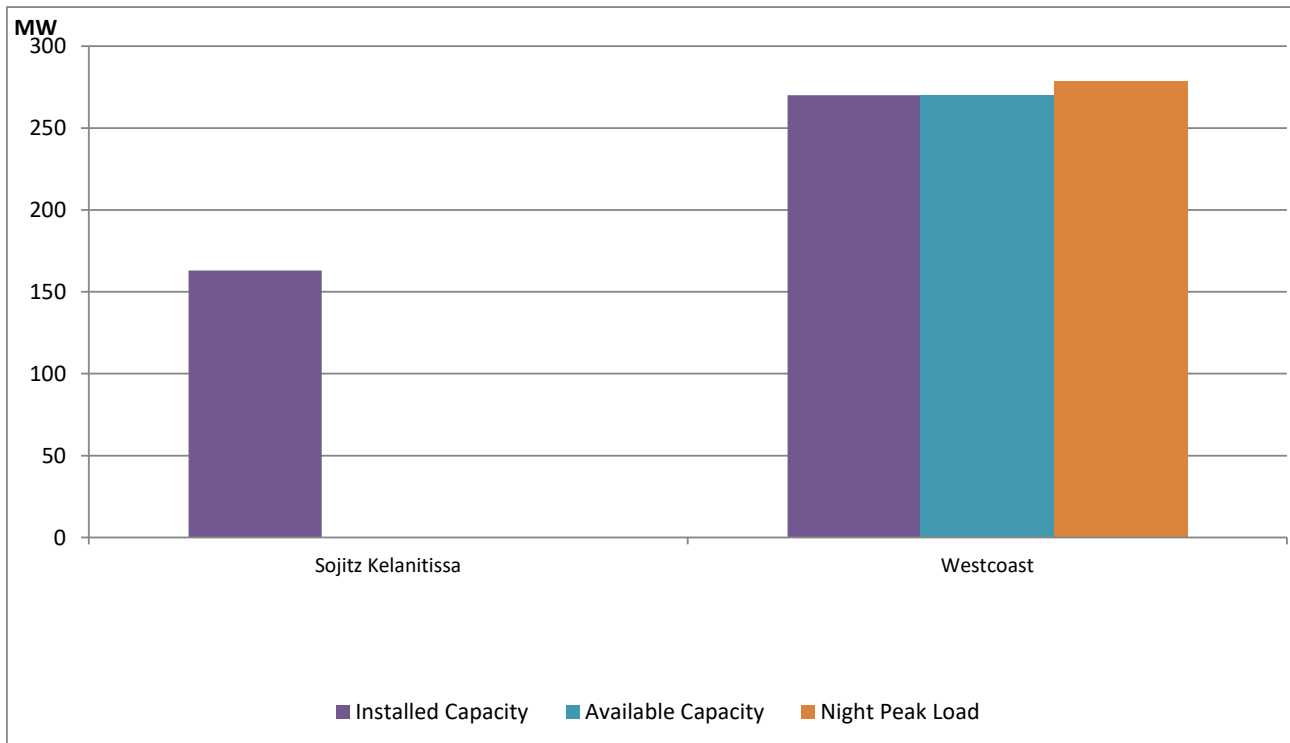


Note- Plant availability is recorded at 6.00 am on

February 4, 2022

Major Hydro Plant Dispatch

February 3, 2022

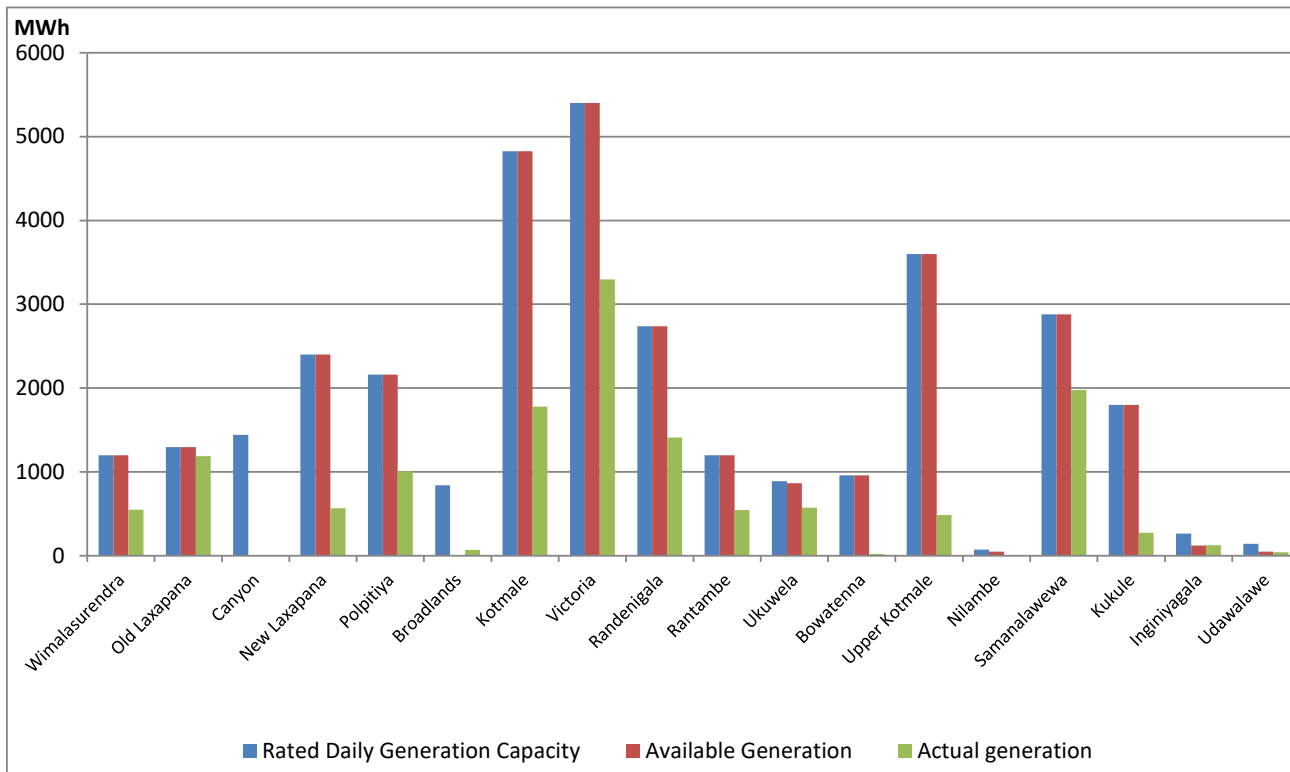


Available Generation is estimated based on plant availability at 6.00am on
Broadlands power plant is operating in the Commissioning Stage

February 4, 2022

Major Hydro Plant Loading at Night Peak

February 3, 2022

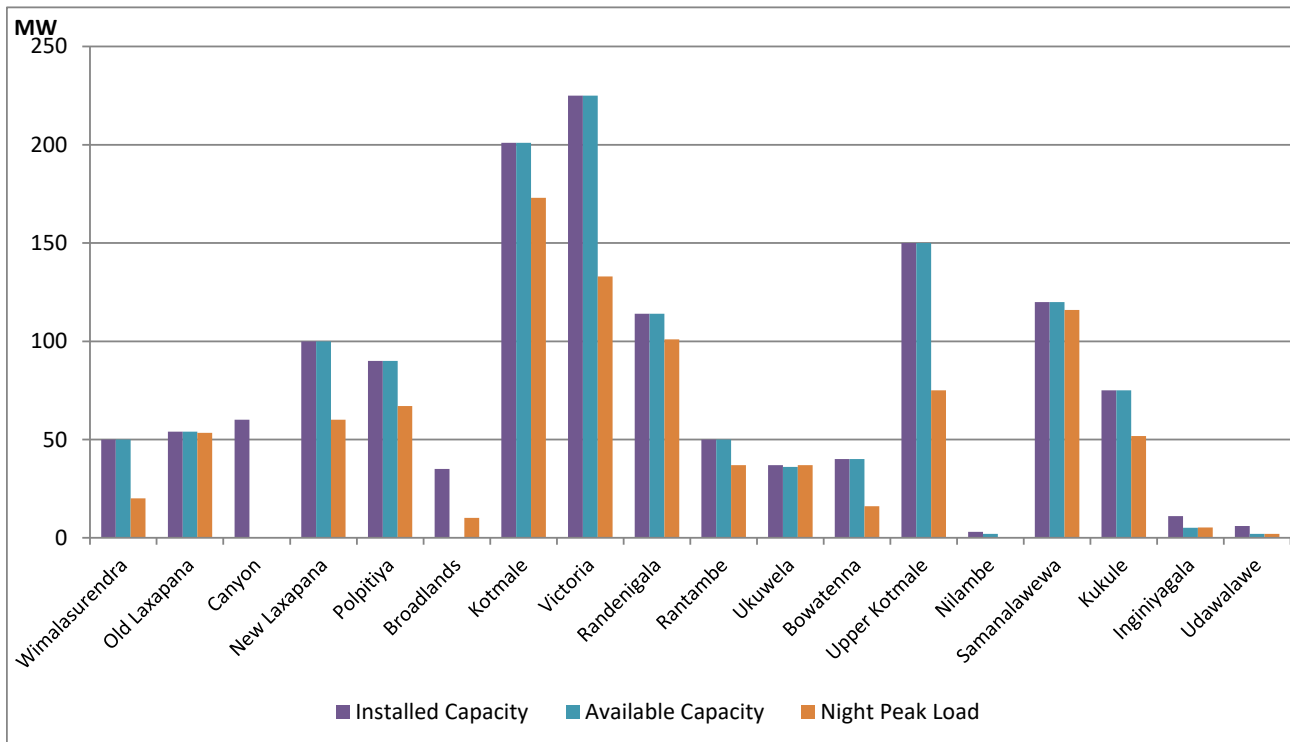

Note- Plant availability is recorded at 6.00 am on
Broadlands power plant is operating in the Commissioning Stage

February 4, 2022

Summary of Major Plant performance


Plant	Installed Capacity (MW)	Plant Availability (MW)	Night peak Load (MW)	Plant Dispatch (MWh)
Wimalasurendra	50	50	20	550
Old Laxapana	54	54	53	1,188
Canyon	60	0	0	0
New Laxapana	100	100	60	568
Polpitiya	90	90	67	1,009
Broadlands	35	0	10	71
Kotmale	201	201	173	1,780
Victoria	225	225	133	3,298
Randenigala	114	114	101	1,411
Rantambe	50	50	37	544
Ukuwela	37	36	37	574
Bowatenna	40	40	16	22
Upper Kotmale	150	150	75	485
Nilambe	3	2	0	7
Samanalawewa	120	120	116	1,975
Kukule	75	75	52	274
Inginiyagala	11	5	5	124
Udawalawe	6	2	2	43
Puttalam Coal I	270	270	272	6,514
Puttalam Coal II	270	270	272	6,494
Puttalam Coal III	270	270	270	6,507
KPS Small GTs	64	0	0	0
KPS GT 7	115	0	0	0
KCCP	161	0	0	0
Sapugaskanda A	70	0	48	259
Sapugaskanda B	70	63	61	1,417
Uthura Janani	26	16	23	416
Barge CEB	60	60	-1	940
CEB-Thulhiriya	10	8	8	138
CEB-Kolonnawa	20	15	15	277
CEB-Mathugama	20	12	11	127
Sojitz Kelanitissa	163	0	0	0
West Coast	270	270	279	4,658
Total	3,280	2,568	2,263	43,103

Plant availability is the availability recorded at 6 am on

February 4, 2022

Contribution to the Night Peak in MW


February 3, 2022

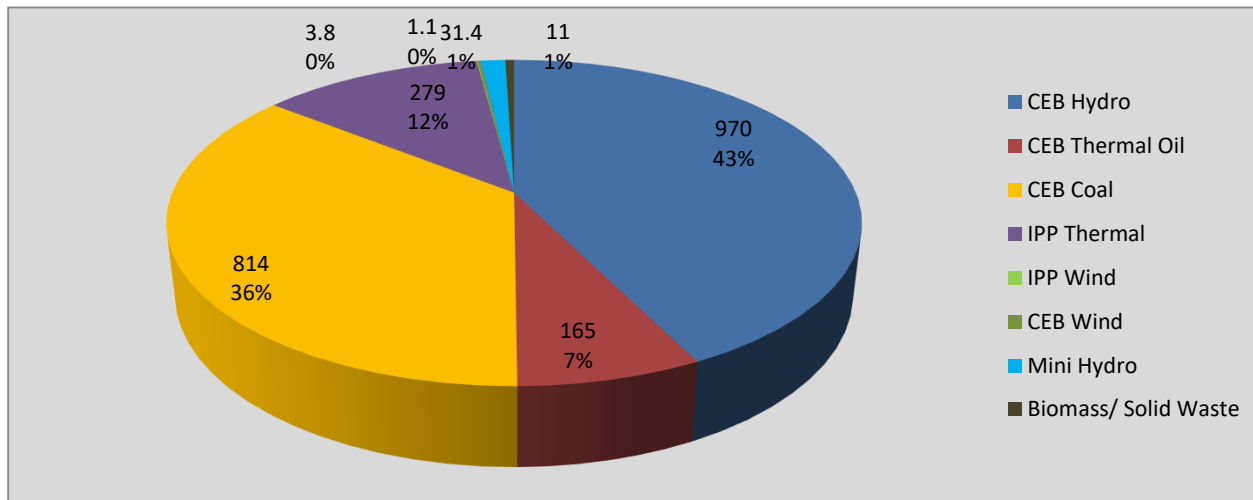

Night Peak*	2,275.1 MW
Day Peak	2,170.8 MW
Minimum Demand	1,380.3 MW


Above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants

Reservoir Levels - as at 06.00 Hr on February 4, 2022

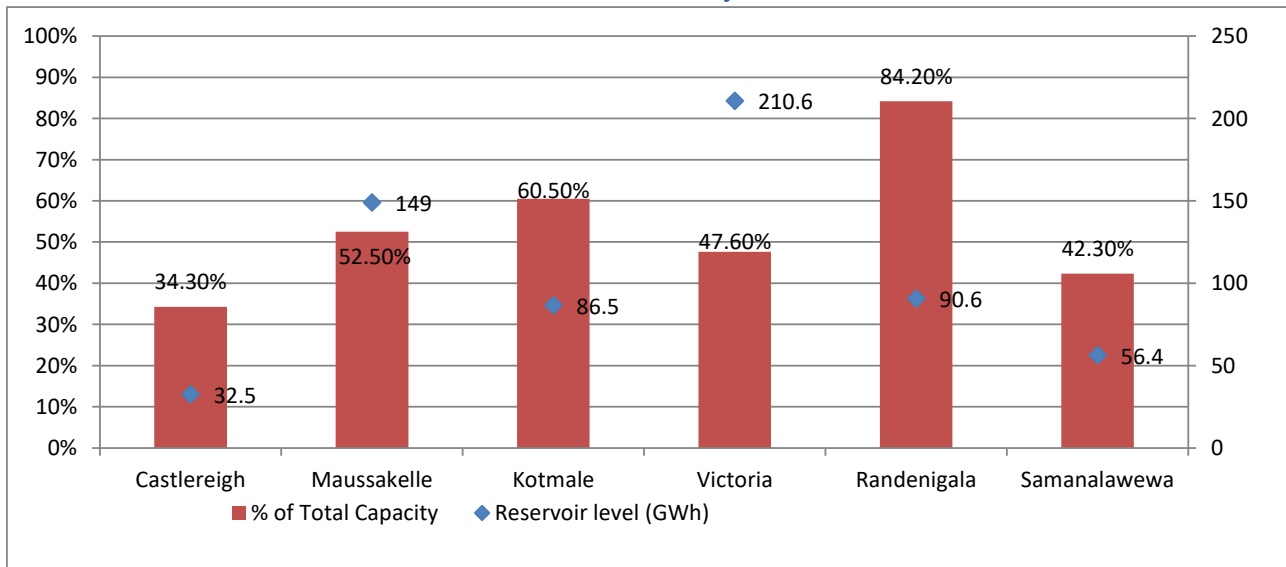


Total Reservoir Level(GWh)	625.6
% of Total capacity	53.6%

Comparison of Total Reservoir Storage Levels with Past Years

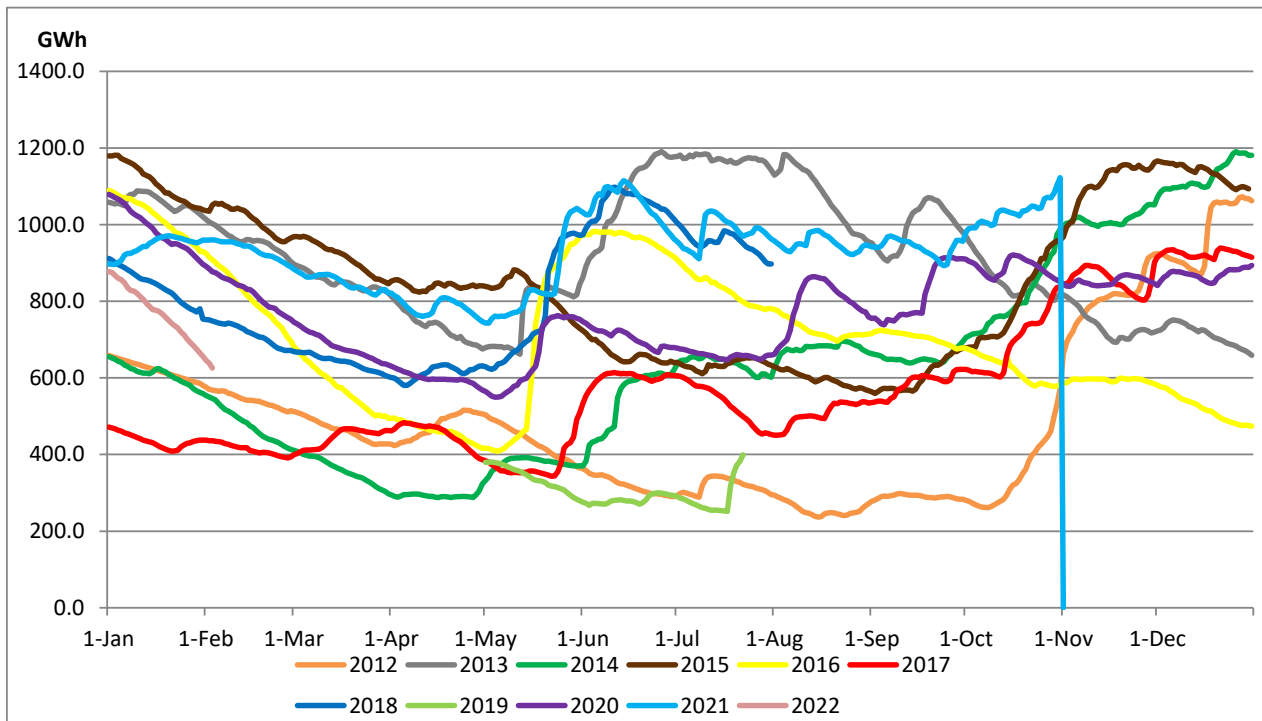


Data for 2018 and 2019 are only available for part of year.

Variation of Major Hydro Reservoir Levels in the current year (GWh)

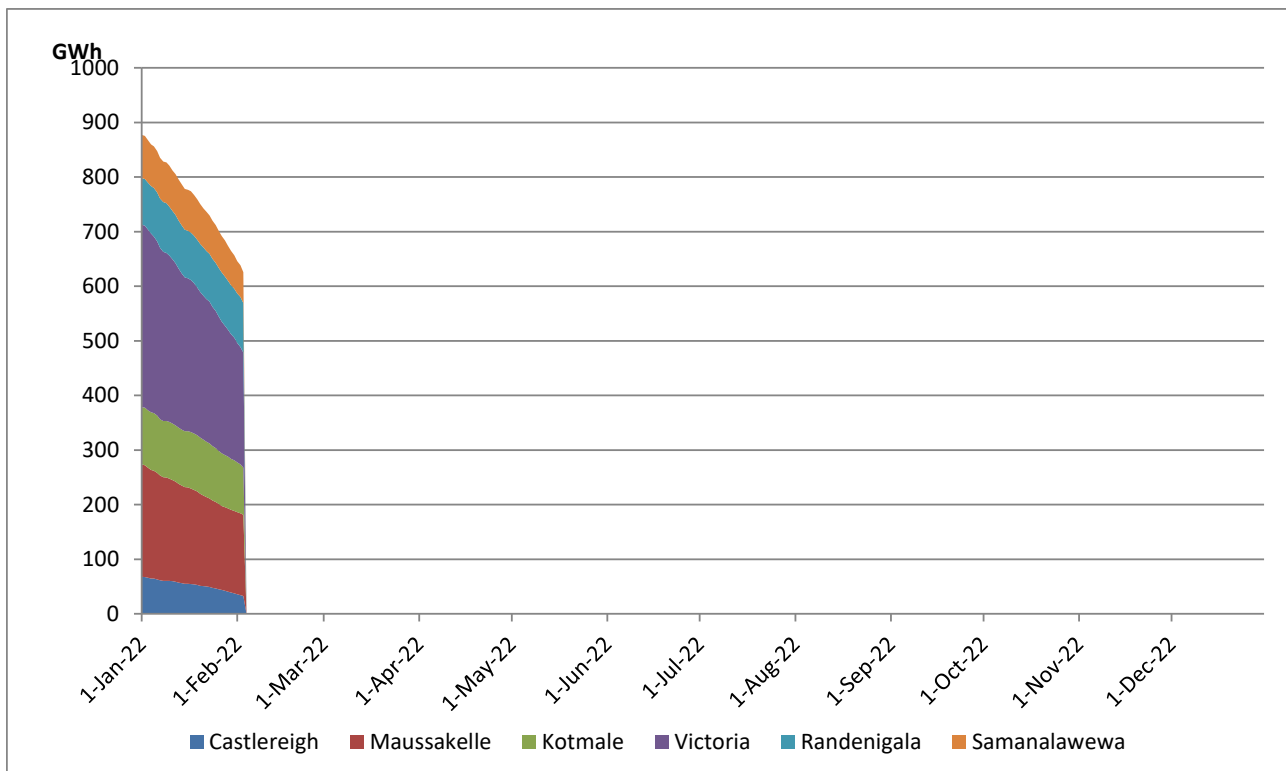

Variation of Demand during the current year

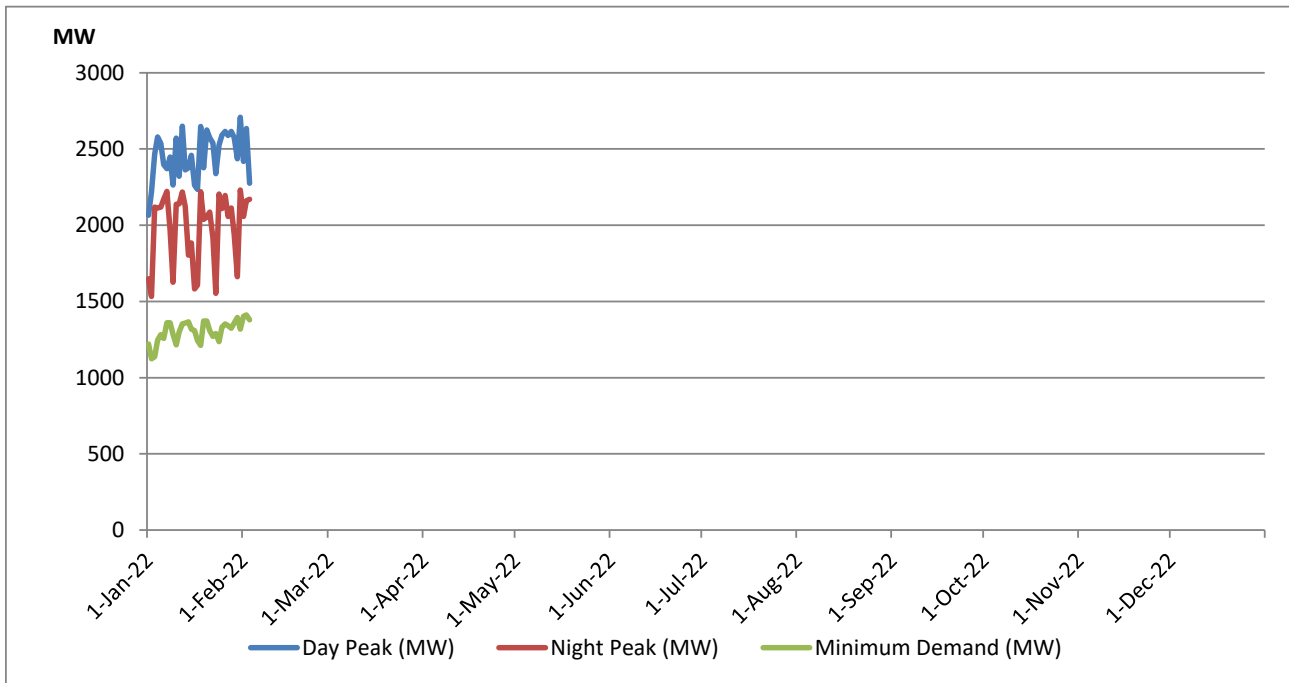


The above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants

Daily Load Curve of the Previous day


February 2, 2022

Solar and wind data is based on Telemetered Power Stations only

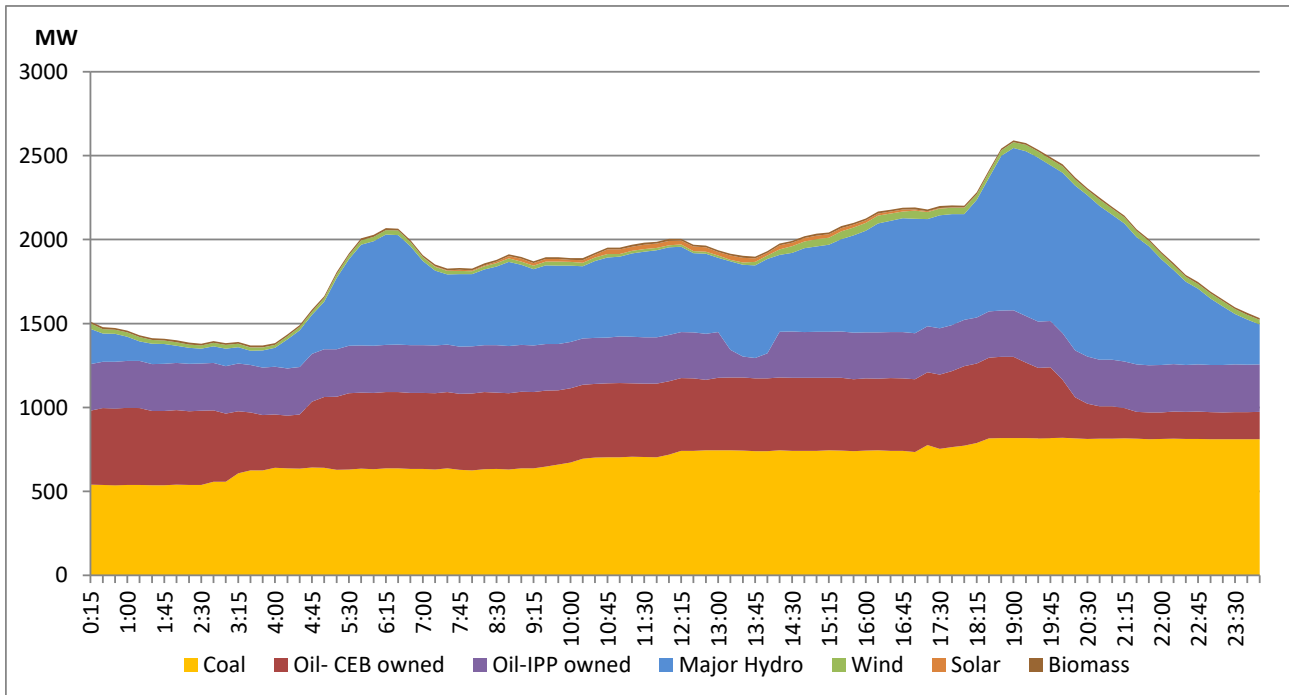


Coal Generation during the Previous day

February 2, 2022

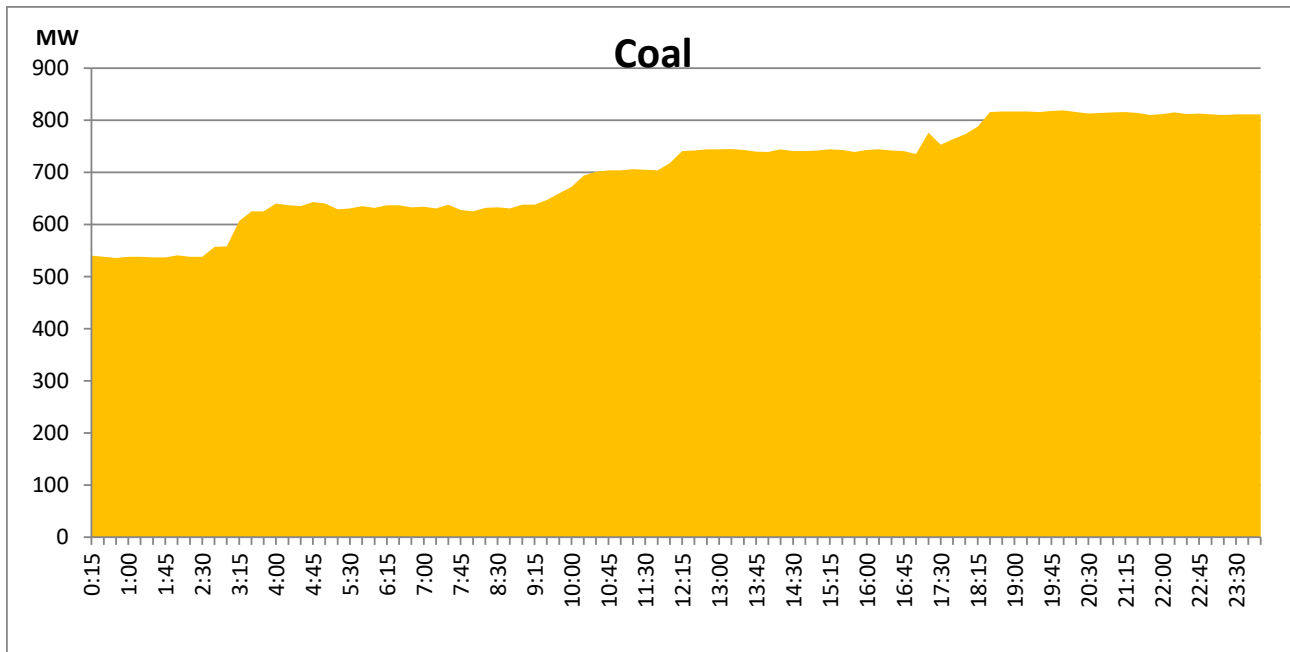


CEB Oil Plant Generation during the Previous day

February 2, 2022

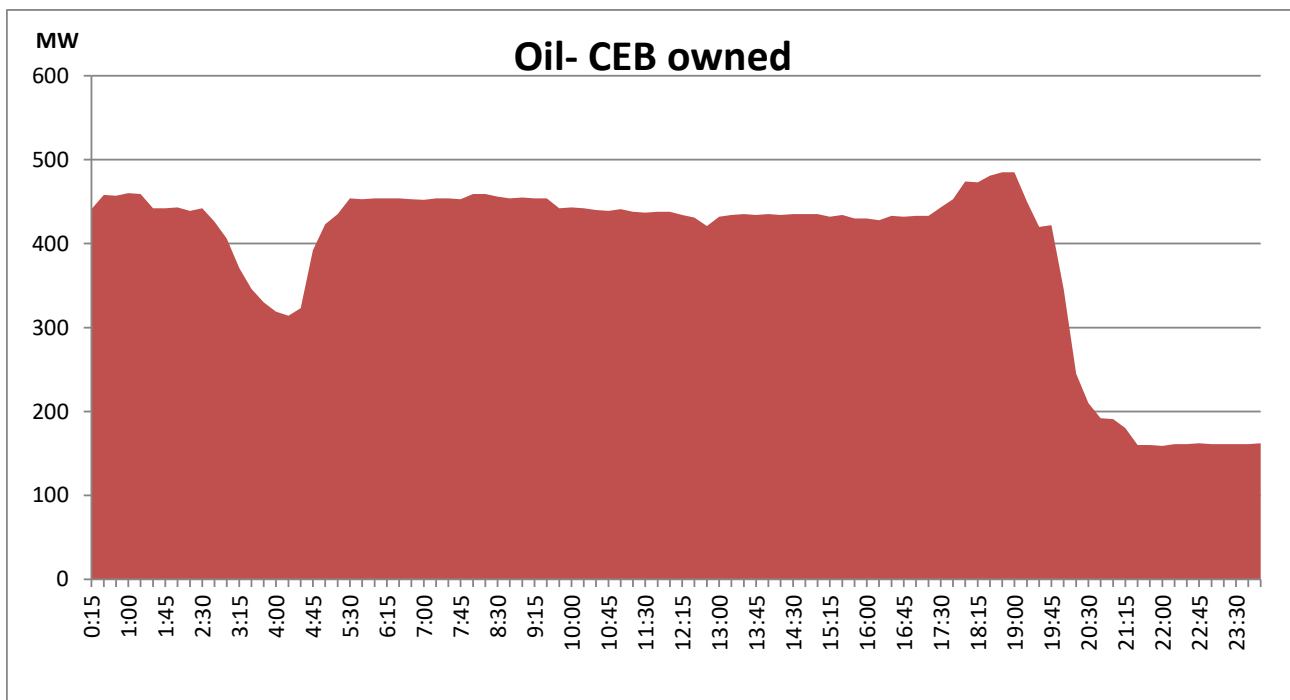


IPP Oil Plant Generation during the Previous day

February 2, 2022

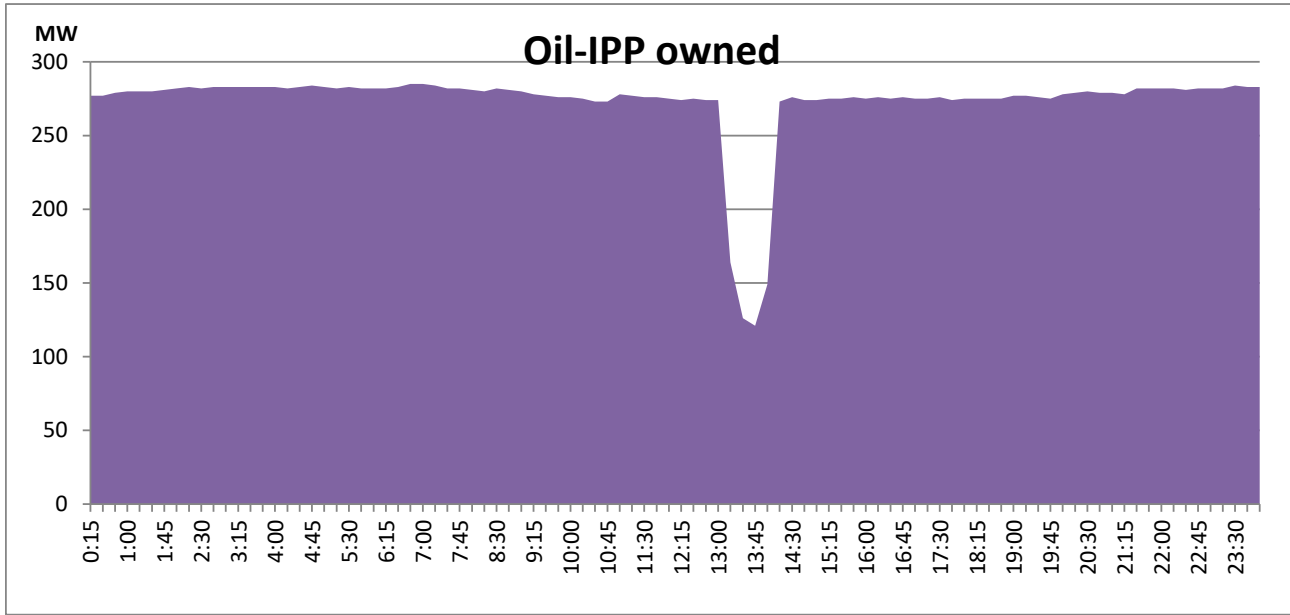

Major Hydro Generation during the Previous day


February 2, 2022

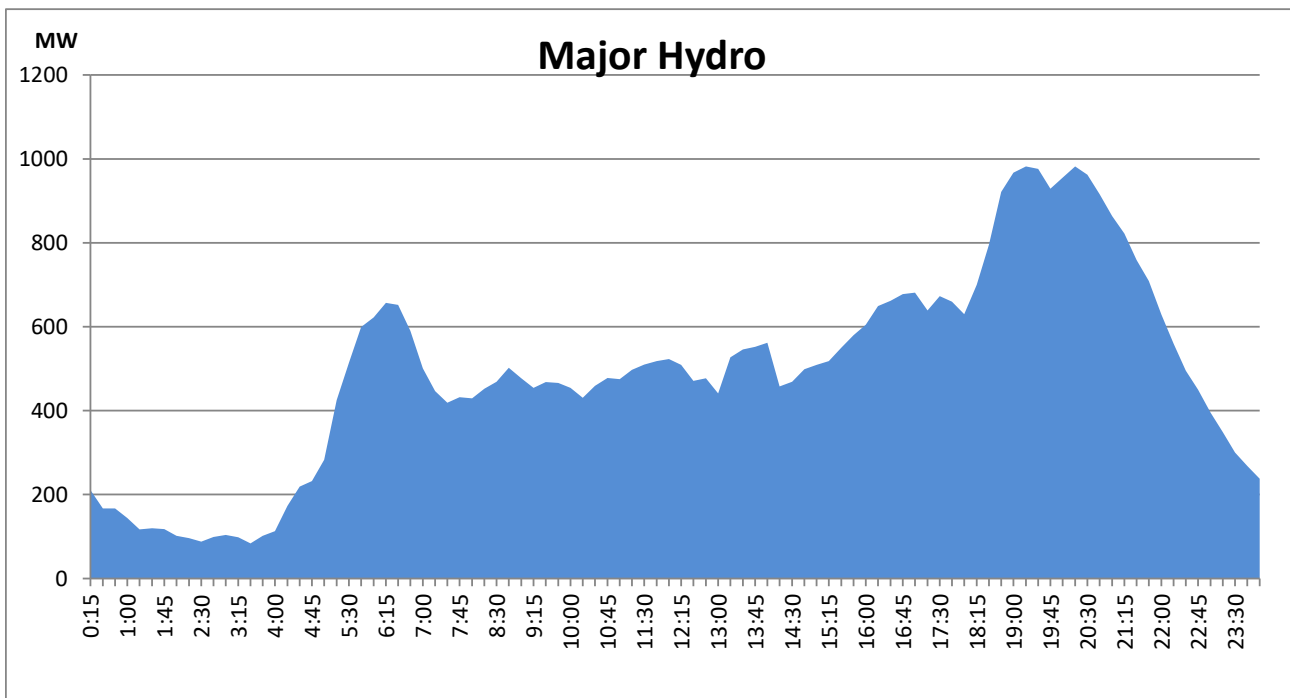

Wind Generation during the Previous day

February 2, 2022


Based on Telemetered Power Stations only

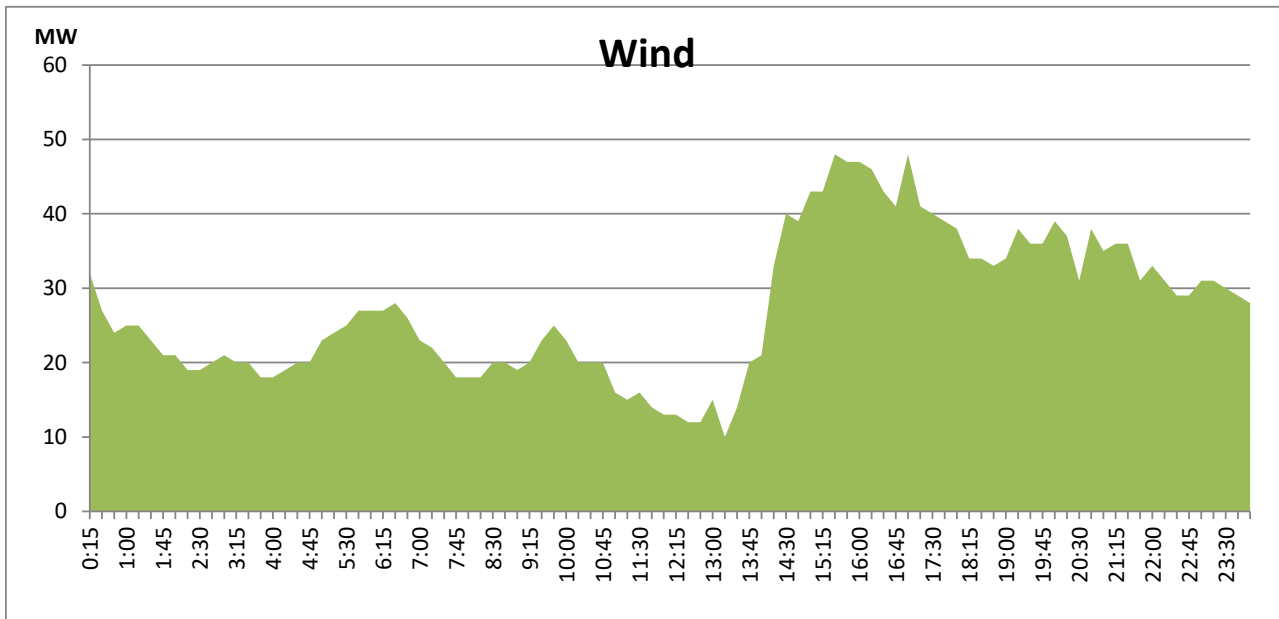

Solar Generation during the Previous day

February 2, 2022

Based on Telemetered Power Stations only

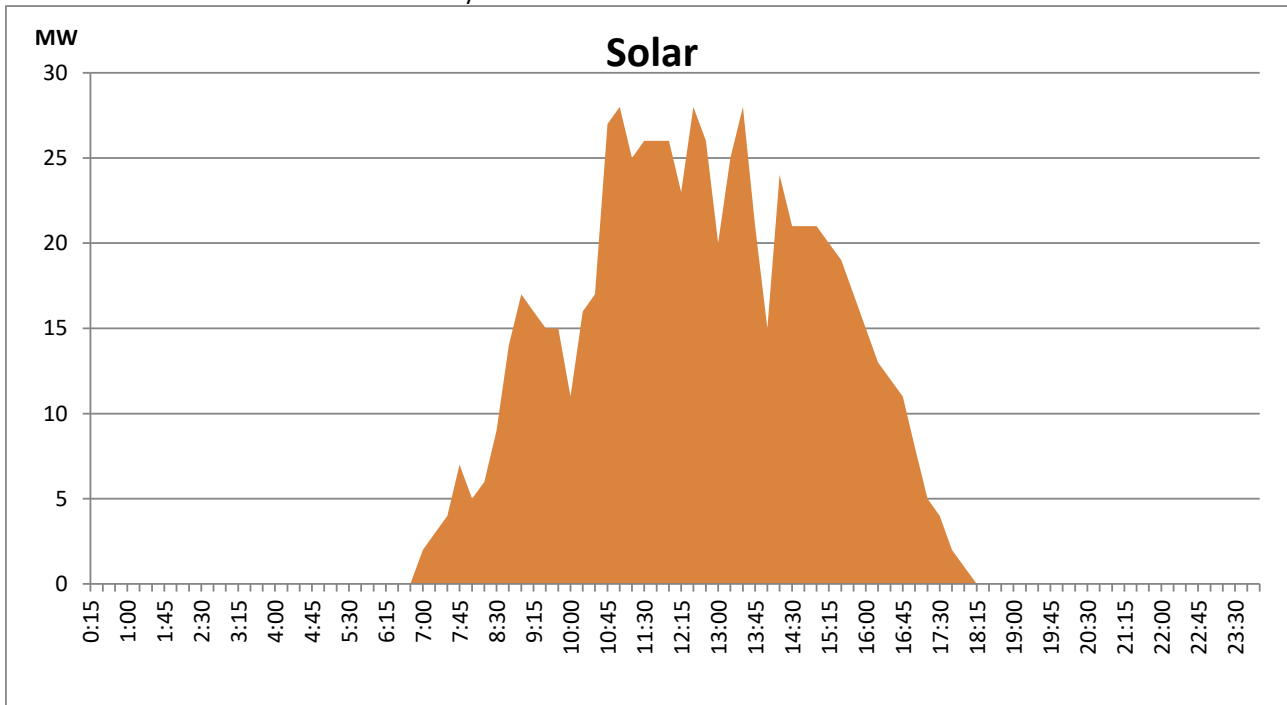

Thermal Plant Fuel types

Power Station	Primary Fuel
CEB Thermal	
Sapugaskanda 1	Heavy Fuel
Sapugaskanda 2	Heavy Fuel
Kelanitissa Small Gas Turbines	Auto Diesel
GT 7 - Kelanitissa	Auto Diesel
Kelanitissa CCY	Naptha & Diesel
Lakvijaya 1	Coal
Lakvijaya 2	Coal
Lakvijaya 3	Coal
Uthuru Janani	Heavy Fuel
Barge CEB	Furnace Oil

Power Station	Primary Fuel
Private Thermal	
Sojitz - Kelanitissa	Auto Diesel
West Coast	Low Sulphur Furnace oil

Major Incidents during the day -as reported by CEB morning of

February 4, 2022

2) Kappalthurai 132/33kV T/F 02, which was tripped 16:40 hrs on 01/02/2022 normalized at 17:22 hrs.