


# Generation and Reservoirs Statistics

October 2, 2022



PUBLIC UTILITIES COMMISSION OF SRI LANKA

## Daily Generation Mix in MWh

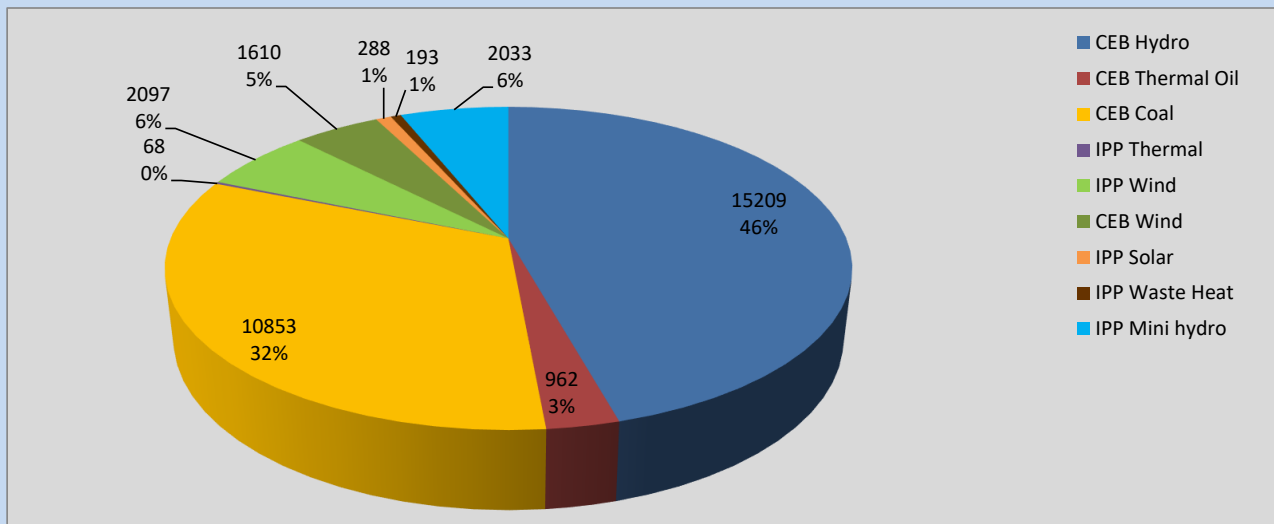

**Total Generation 33,313 MWh**

Note: Above data is excluding contribution from Roof Top Solar, 1MW Solar and certain Mini Hydro plants

## Cumulative Dispatch

Note: Following data is Excluding contribution from Roof Top Solar, 1MW solar and Mini Hydro plants

### For Current Month


Category	Dispatch (GWh)	Percentage
CEB Hydro	29.35	41.57%
CEB Thermal Oil	5.82	8.24%
CEB Coal	21.00	29.74%
IPP Thermal	0.92	1.30%
SPP Wind	4.54	6.43%
CEB Wind	3.61	5.11%
SPP Solar	0.57	0.81%
SPP Solid Waste	0.45	0.64%
Mini Hydro	4.35	6.16%
<b>Total</b>	<b>70.61</b>	

### For Current Year

Category	Dispatch (GWh)	Percentage
CEB Hydro	3,729.5	33.48%
CEB Thermal Oil	1,184.5	10.63%
CEB Coal	4,062.2	36.46%
IPP Thermal	1,076.7	9.66%
SPP Wind	285.5	2.56%
CEB Wind	309.7	2.78%
SPP Solar	72.0	0.65%
SPP Solid Waste	55.3	0.50%
Mini Hydro	364.9	3.28%
<b>Total</b>	<b>11,139.9</b>	

## CEB owned Thermal Plant Dispatch


October 2, 2022

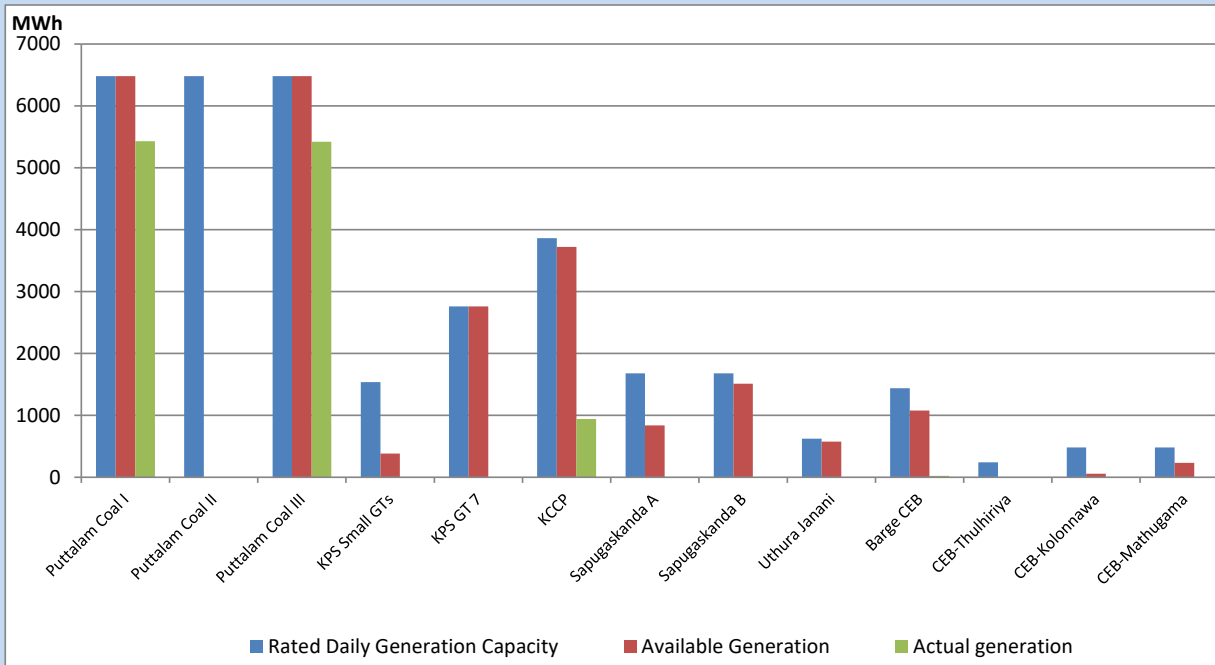

Available Generation is estimated based on plant availability at 6.00am on

October 3, 2022

## CEB owned Thermal Plant Loading at the Night Peak

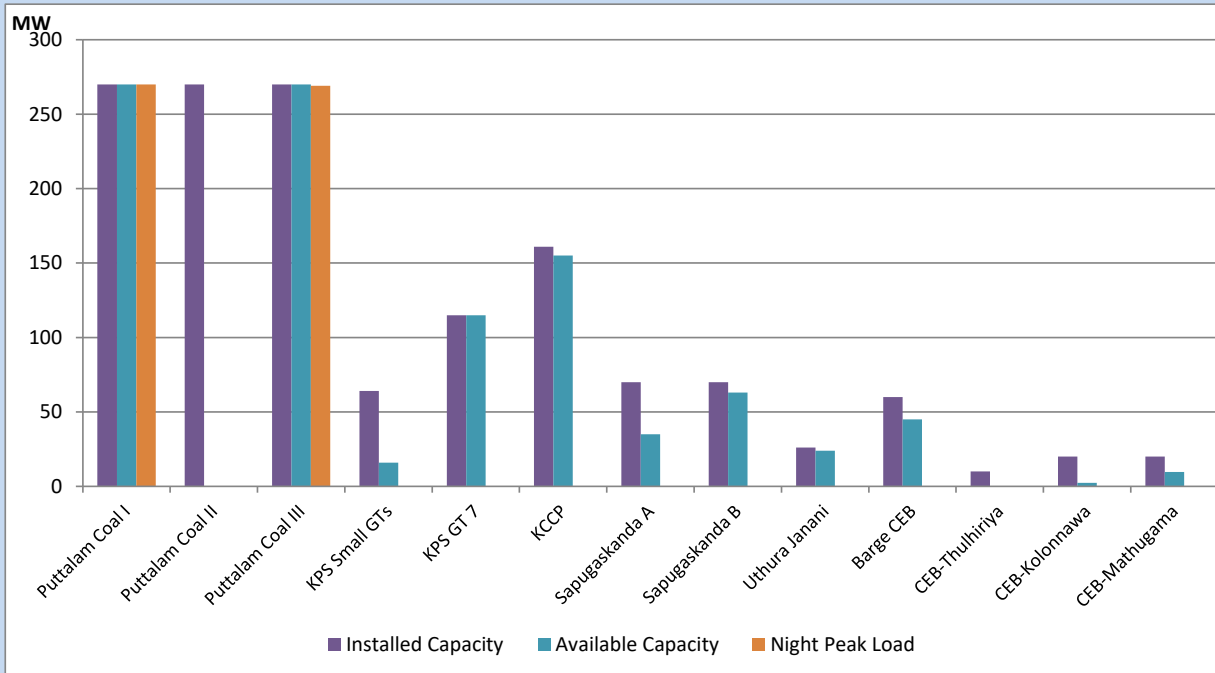


Note- Plant availability is recorded at 6.00 am on

October 3, 2022

## IPP owned Thermal Plant Dispatch

October 2, 2022


Asia Power, V Power Pallekale, Vpower Galle, V Power Horana, Vpower Hambantota, Vpower Valachchena and Altaqa Mahiyanganaya are not available due to expiration of PPAs

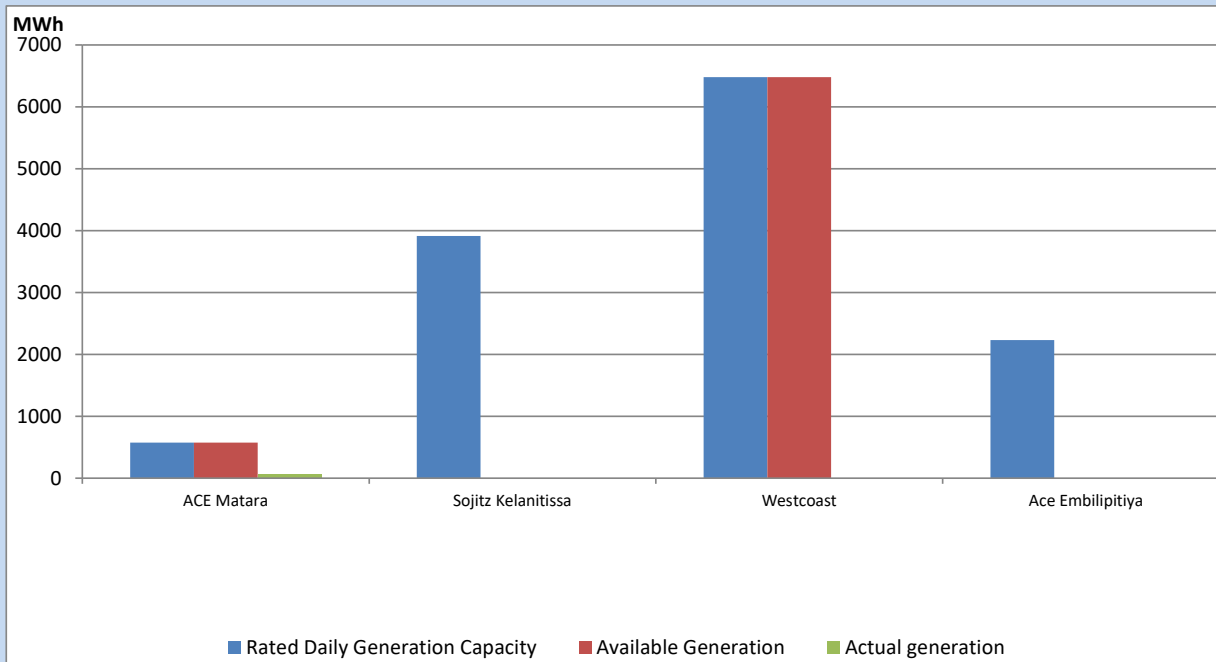

Available Generation is estimated based on plant availability at 6.00am on

October 3, 2022

## IPP owned Thermal Plant Loading at the Night Peak

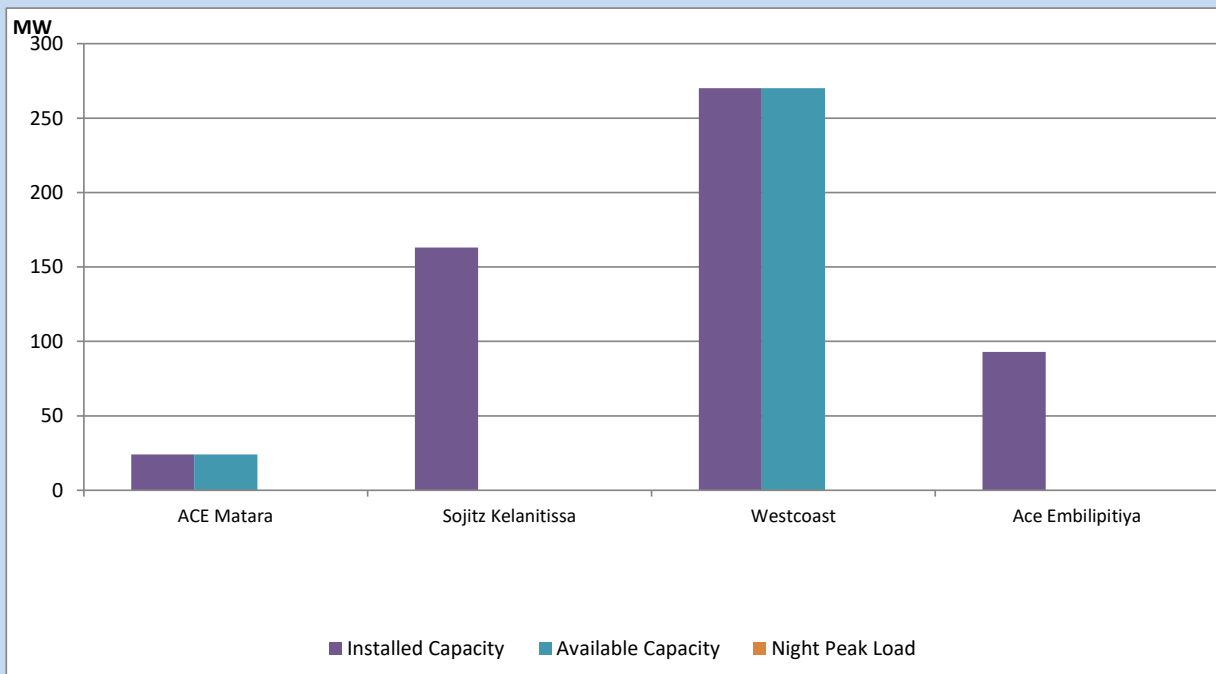


Note- Plant availability is recorded at 6.00 am on

October 3, 2022

## Major Hydro Plant Dispatch

October 2, 2022

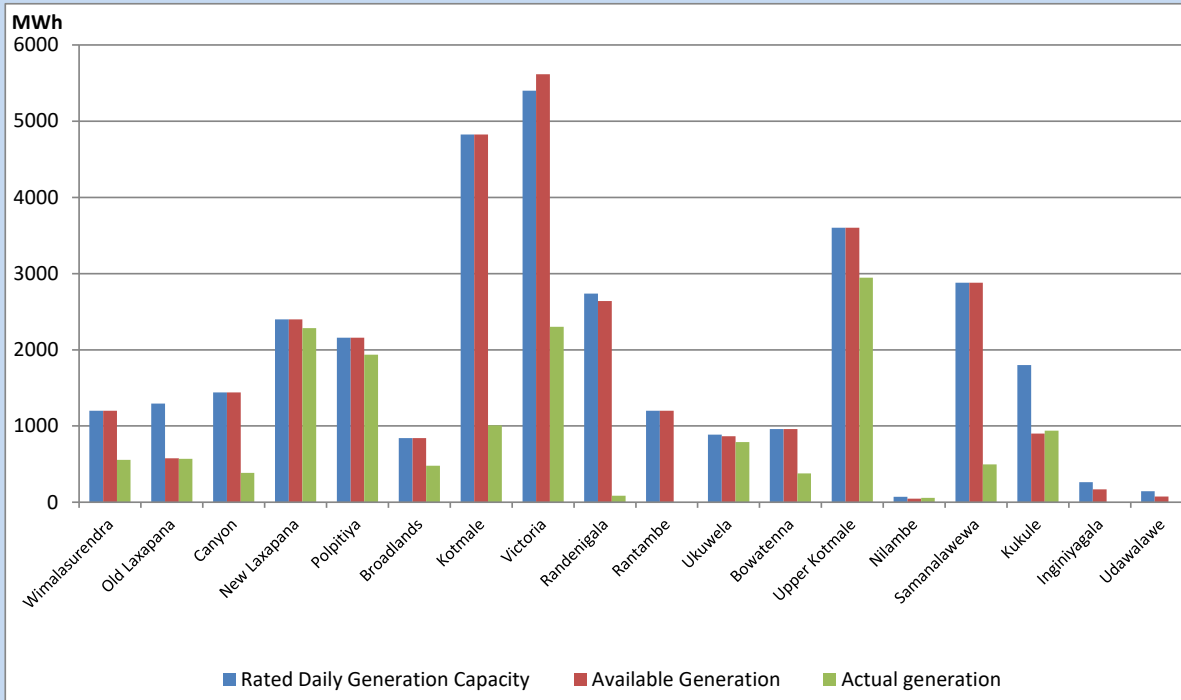


Available Generation is estimated based on plant availability at 6.00am on  
Broadlands power plant is operating in the Commissioning Stage

October 3, 2022

## Major Hydro Plant Loading at Night Peak

October 2, 2022

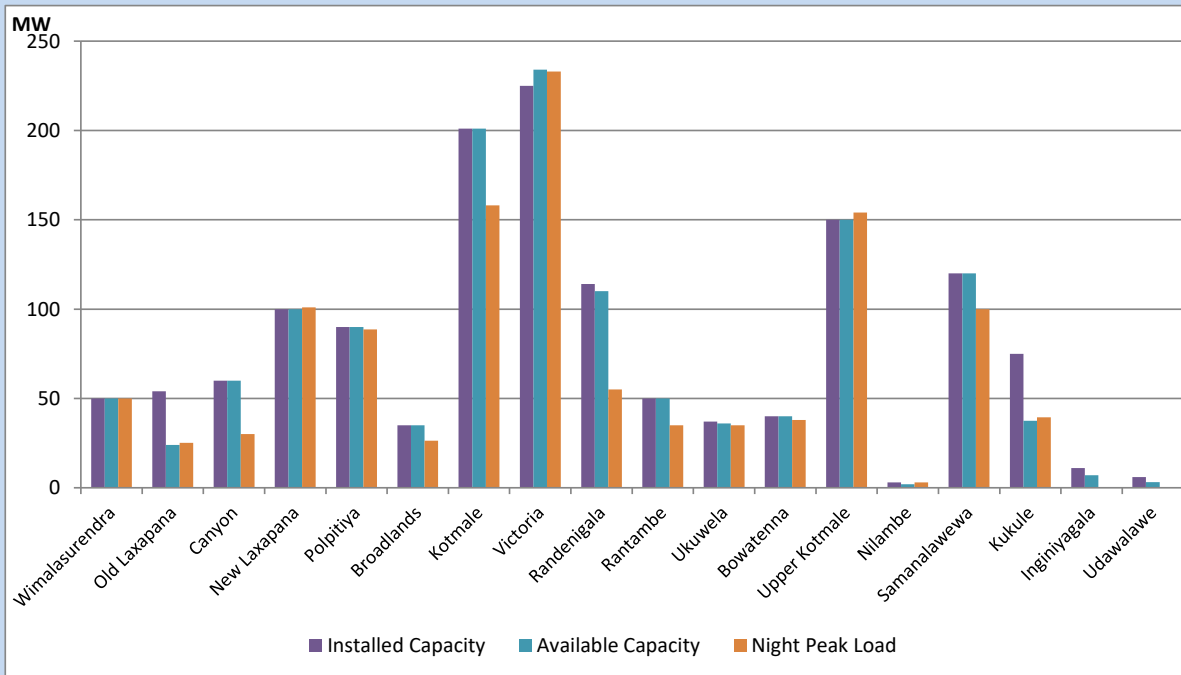

Note- Plant availability is recorded at 6.00 am on  
Broadlands power plant is operating in the Commissioning Stage

October 3, 2022

## Summary of Major Plant performance


Plant	Installed Capacity	Plant Availability	Night peak Load	Plant Dispatch
	(MW)	(MW)	(MW)	(MWh)
Wimalasurendra	50	50	50	555
Old Laxapana	54	24	25	568
Canyon	60	60	30	383
New Laxapana	100	100	101	2,283
Polpitiya	90	90	89	1,934
Broadlands	35	35	26	479
Kotmale	201	201	158	1,010
Victoria	225	234	233	2,303
Randenigala	114	110	55	85
Rantambe	50	50	35	0
Ukuwela	37	36	35	790
Bowatenna	40	40	38	379
Upper Kotmale	150	150	154	2,948
Nilambe	3	2	3	56
Samanalawewa	120	120	100	497
Kukule	75	38	39	939
Inginiyagala	11	7	0	0
Udawalawe	6	3	0	0
Puttalam Coal I	270	270	270	5,431
Puttalam Coal II	270	0	0	0
Puttalam Coal III	270	270	269	5,422
KPS Small GTs	64	16	0	0
KPS GT 7	115	115	0	0
KCCP	161	155	0	940
Sapugaskanda A	70	35	0	0
Sapugaskanda B	70	63	0	0
Uthura Janani	26	24	0	0
Barge CEB	60	45	0	22
CEB-Thulhiriya	10	0	0	0
CEB-Kolonnawa	20	2	0	0
CEB-Mathugama	20	10	0	0
ACE Matara	24	24	0	68
Sojitz Kelanitissa	163	0	0	0
West Coast	270	270	0	0
ACE Embilipitiya	93	0	0	0
<b>Total</b>	<b>3,397</b>	<b>2,649</b>	<b>1,970</b>	<b>33,313</b>

Plant availability is the availability recorded at 6 am on

October 3, 2022

## Contribution to the Night Peak in MW


October 2, 2022

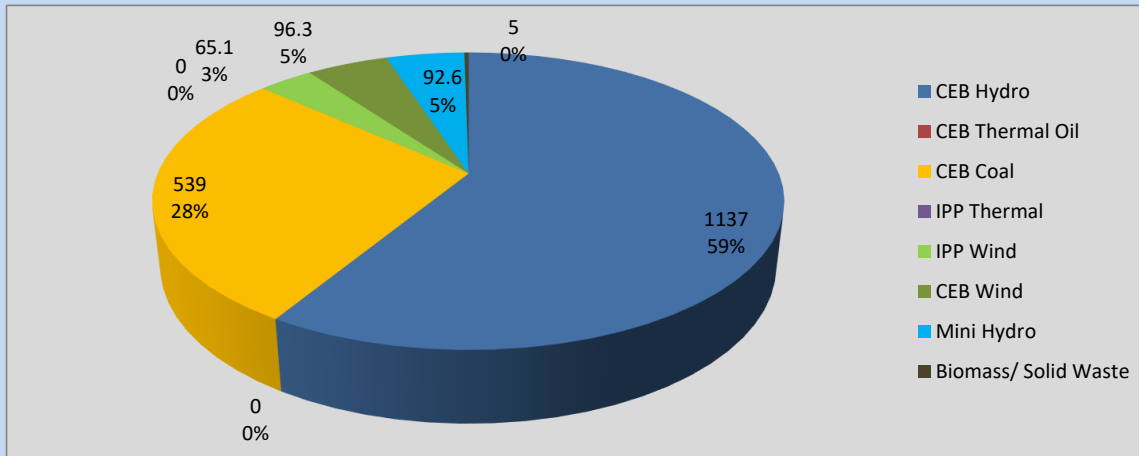

Night Peak*	1,934.6 MW
Day Peak	1,344.2 MW
Minimum Demand	1,126.0 MW


Above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants

## Reservoir Levels - as at 06.00 Hr on October 3, 2022

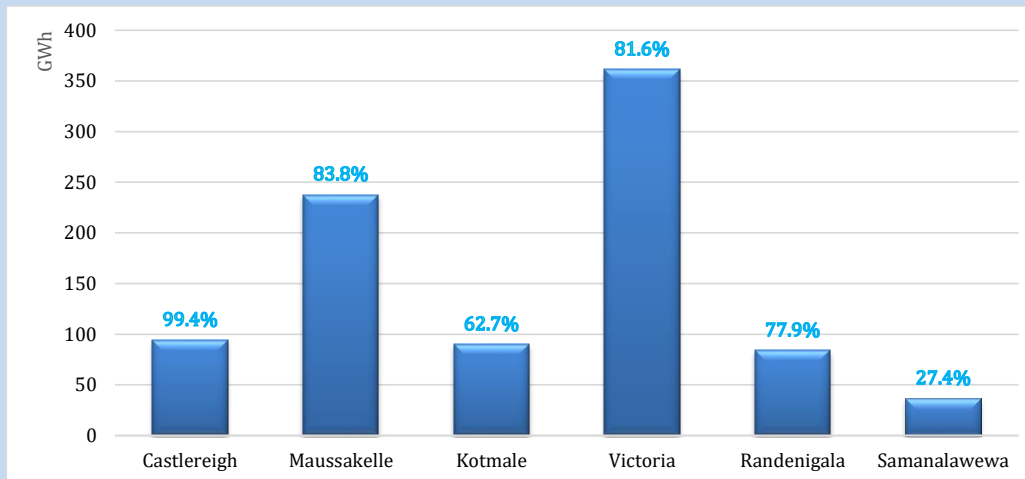


Total Reservoir Level	903.2 GWh
% of Total capacity	74.9%

## Comparison of Total Reservoir Storage Levels with Past Years

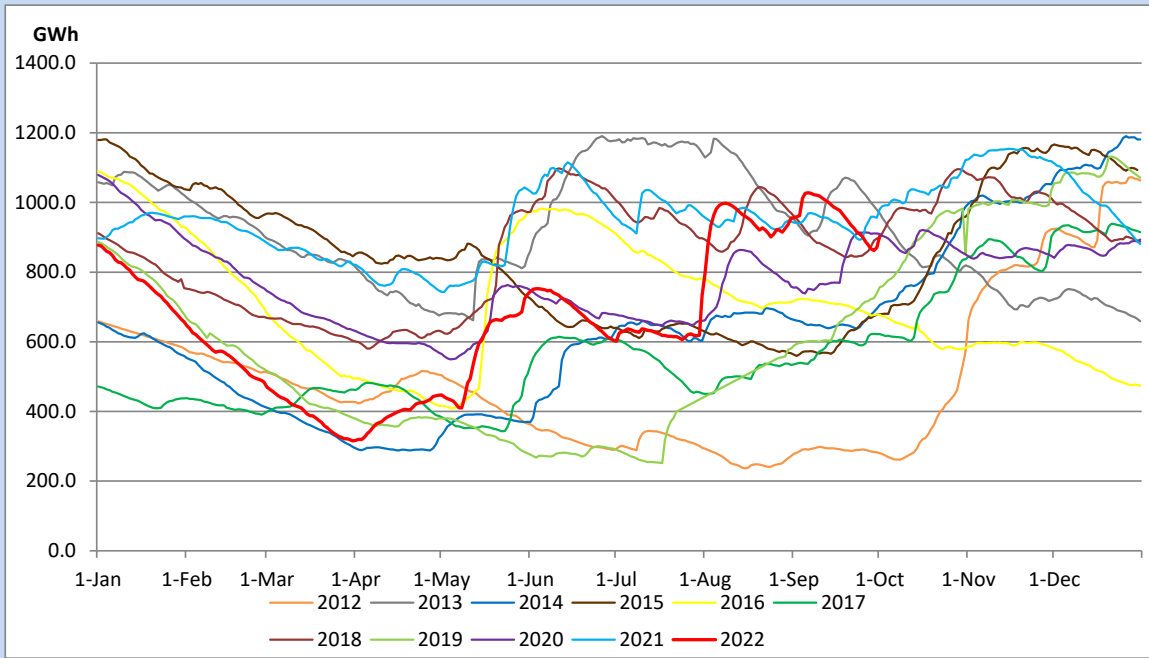


## Variation of Major Hydro Reservoir Levels in the current year (GWh)

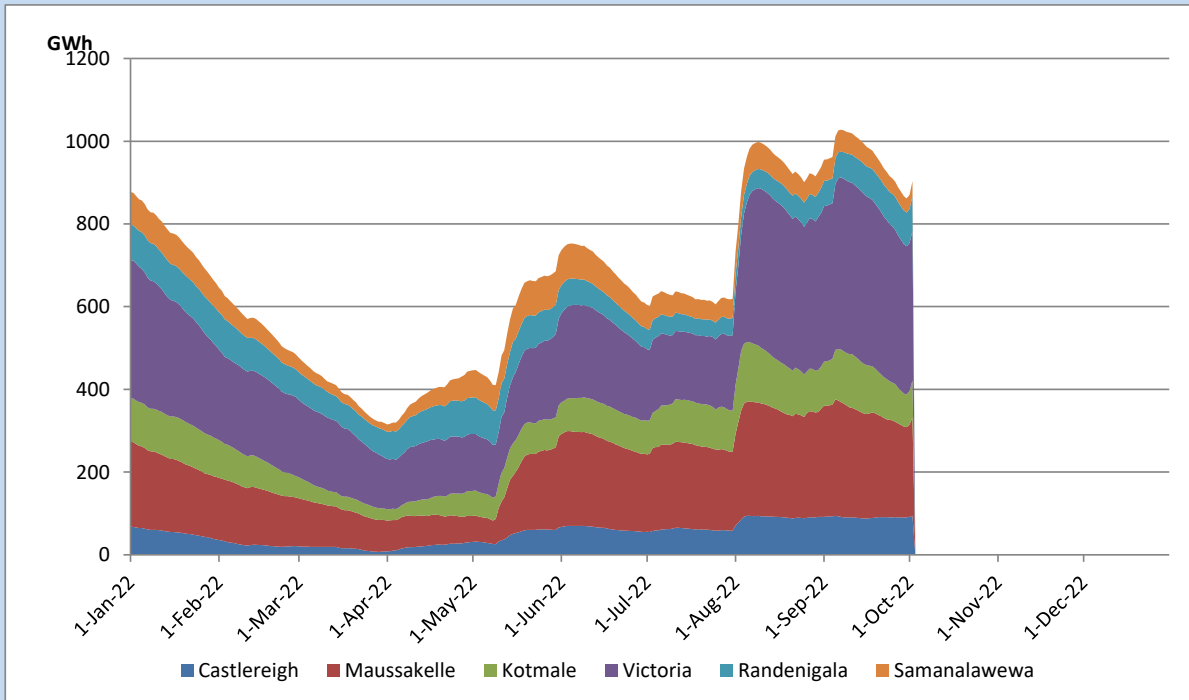



## Variation of Demand during the current year

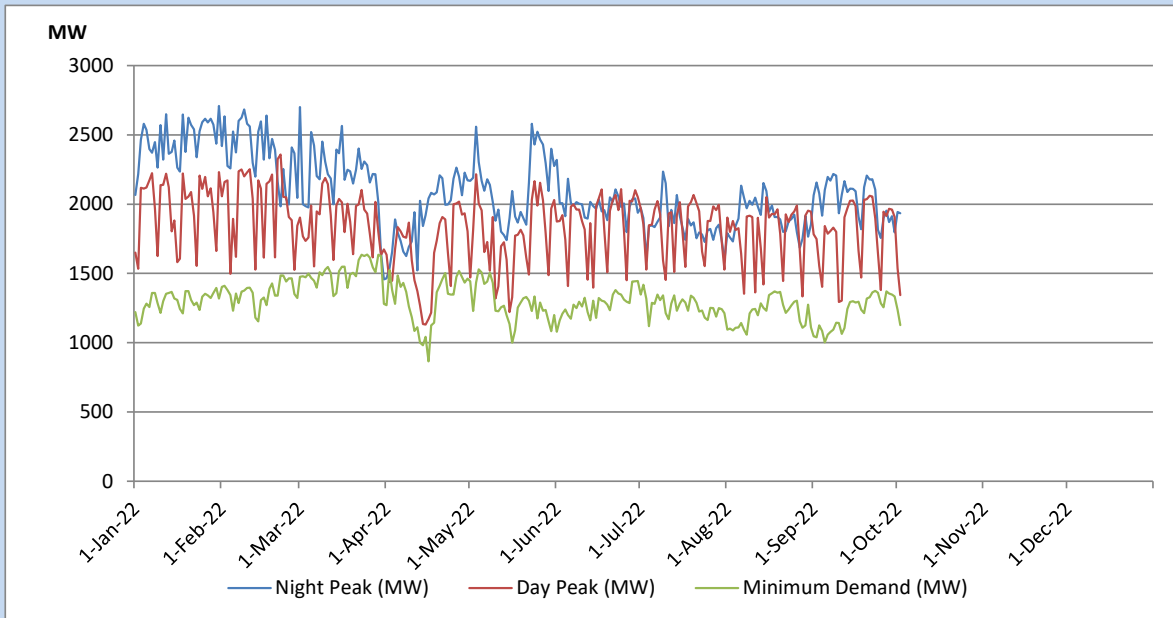


The above figures are excluding contribution from Roof Top Solar, 1MW solar, certain Wind plants and Mini Hydro plants

## Daily Load Curve of the Previous day


October 1, 2022

Solar and wind data is based on Telemetered Power Stations only

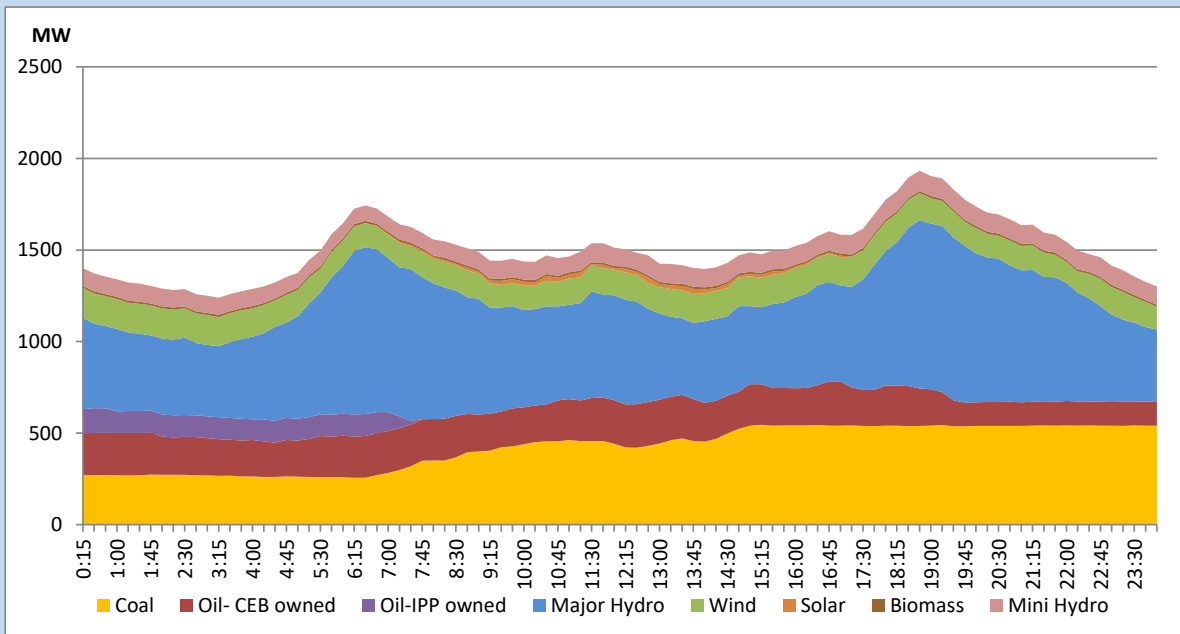


## Coal Generation during the Previous day

October 1, 2022

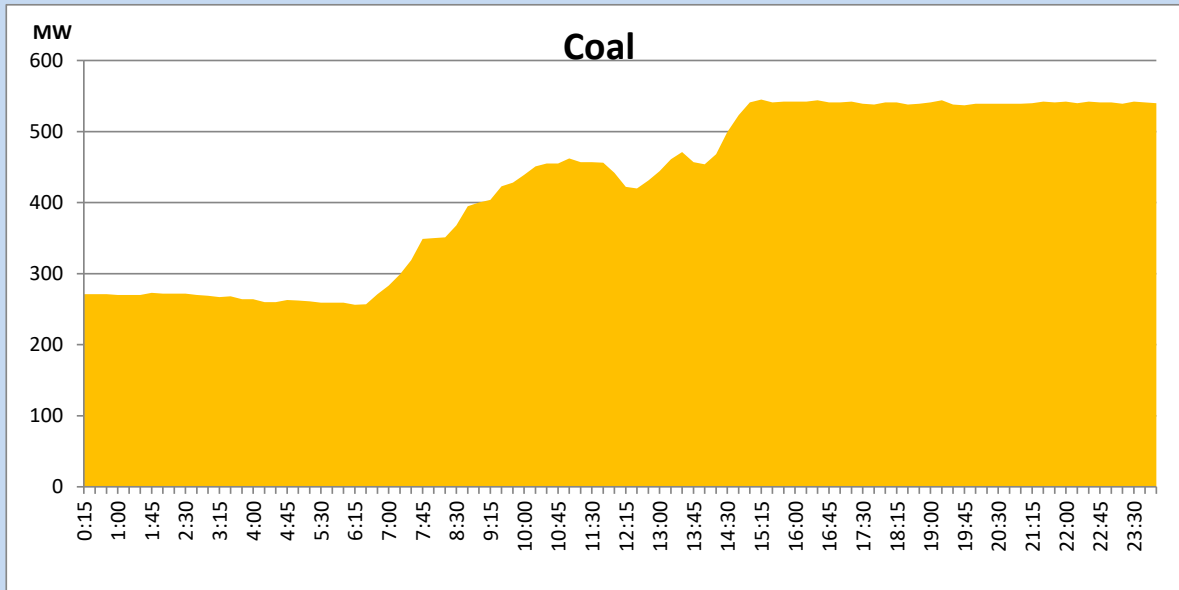


## CEB Oil Plant Generation during the Previous day

October 1, 2022

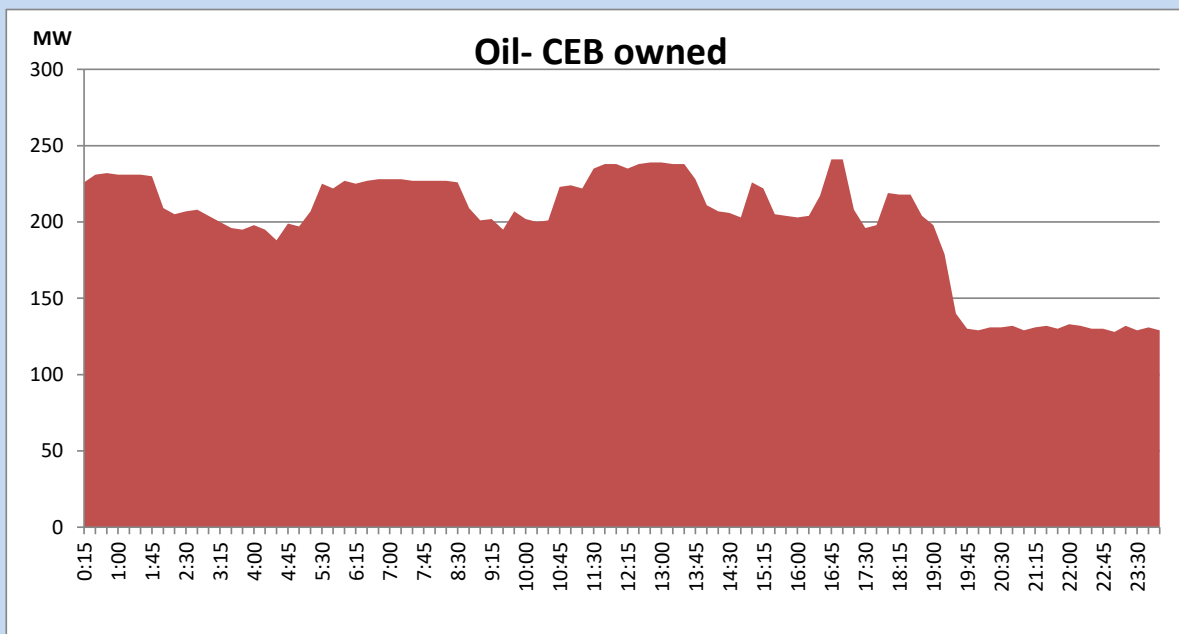


## IPP Oil Plant Generation during the Previous day

October 1, 2022

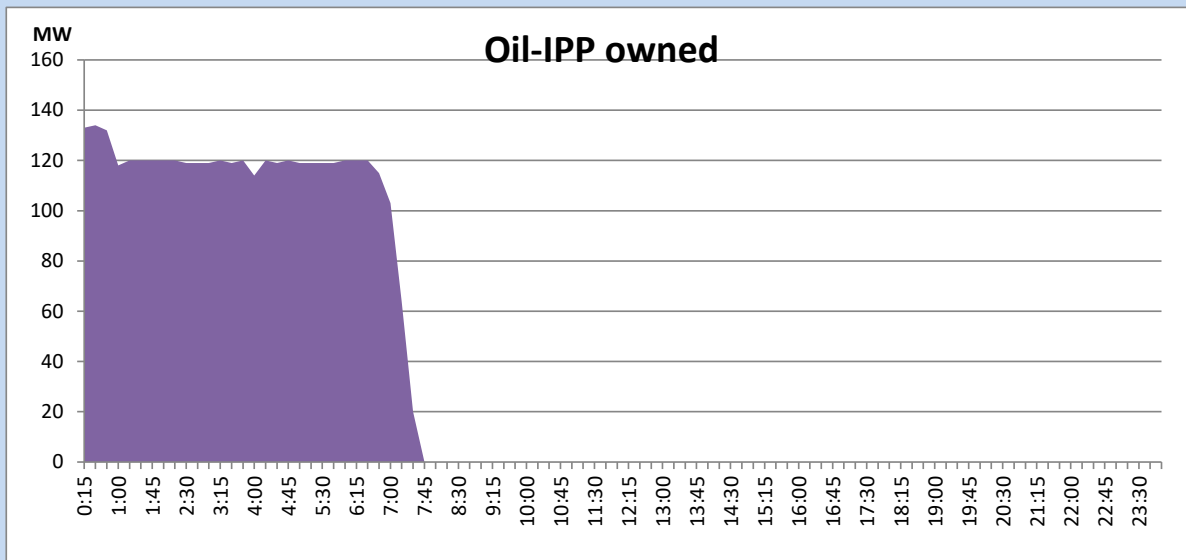

## Major Hydro Generation during the Previous day


October 1, 2022

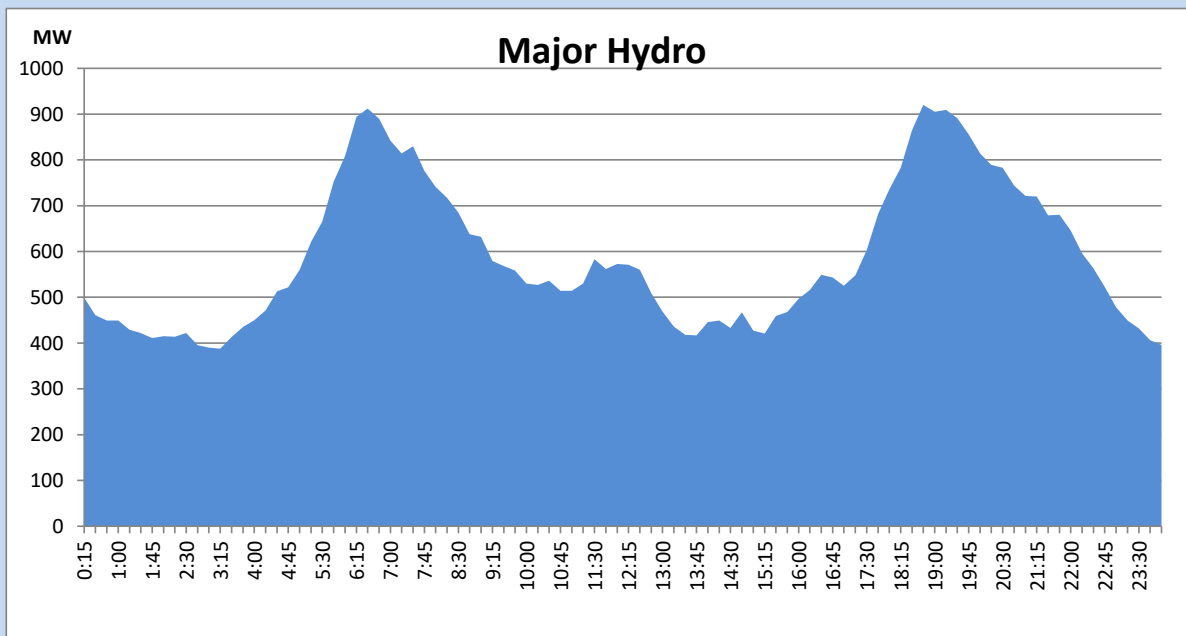

## Wind Generation during the Previous day

October 1, 2022


Based on Telemetered Power Stations only

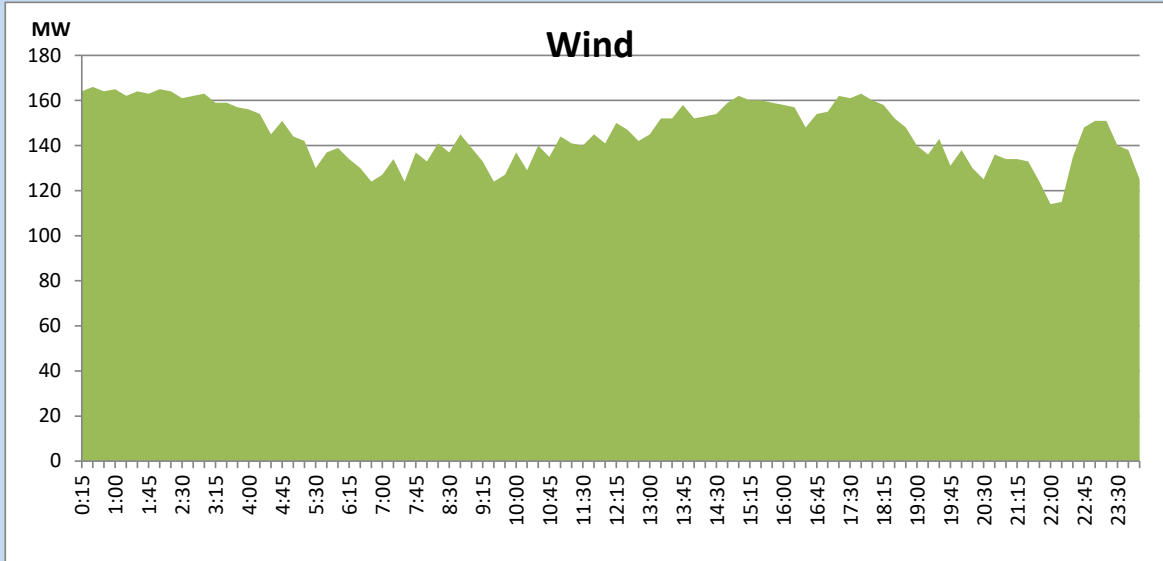


## Solar Generation during the Previous day

October 1, 2022

Based on Telemetered Power Stations only

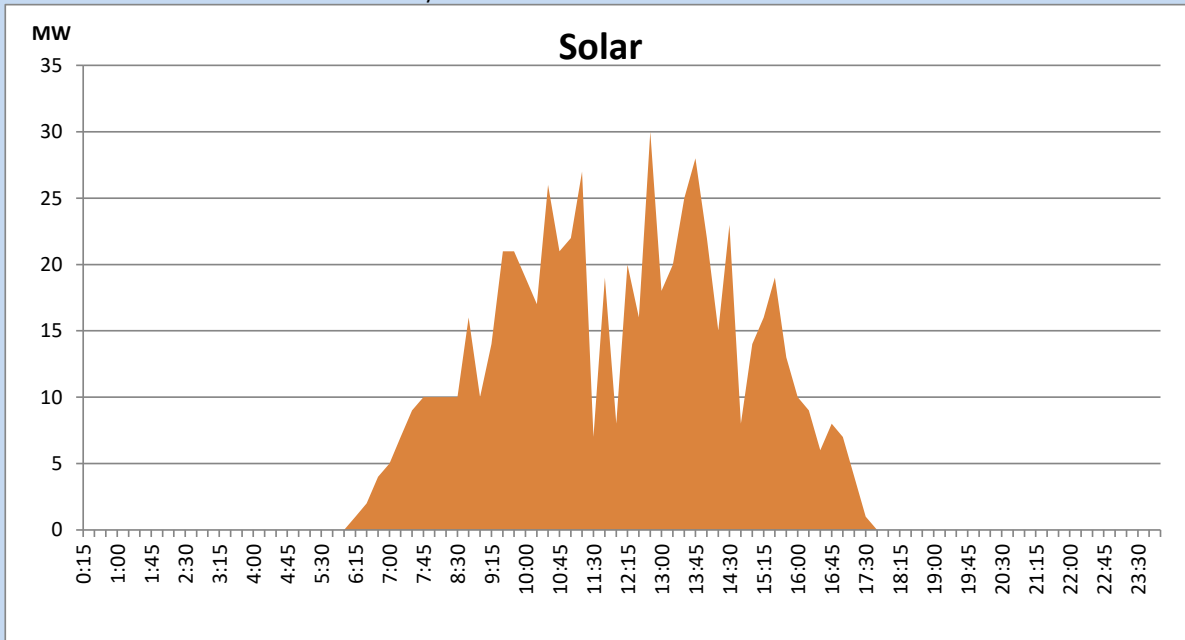

# Cumulative Dispatch Comparison with Last Year

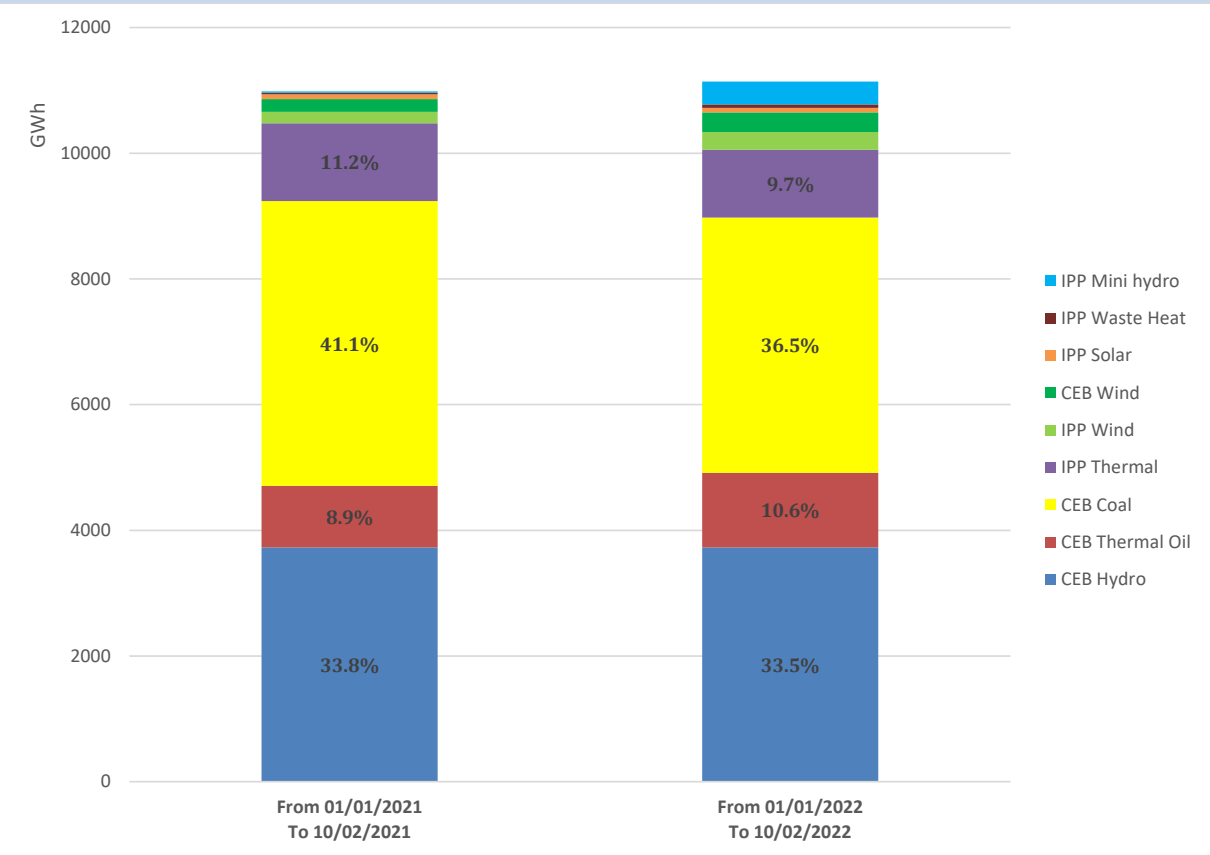

## Thermal Plant Fuel types

Power Station	Primary Fuel
CEB Thermal	
Sapugaskanda 1	Heavy Fuel
Sapugaskanda 2	Heavy Fuel
Kelanitissa Small Gas Turbines	Auto Diesel
GT 7 - Kelanitissa	Auto Diesel
Kelanitissa CCY	Naphtha or Diesel
Lakvijaya 1	Coal
Lakvijaya 2	Coal
Lakvijaya 3	Coal
Uthuru Janani	Heavy Fuel
Barge CEB	Heavy Fuel

Power Station	Primary Fuel
Private Thermal	
Sojitz - Kelanitissa	Auto Diesel
West Coast	Auto Diesel / Heavy Fuel
ACE Matara	Heavy Fuel
ACE Embilipitiya	Heavy Fuel

## Major Incidents during the day -as reported by CEB morning of

October 3, 2022

- 1) Norton pond and Upper Kotmale pond spilling started at 10:58hrs & 18:09hrs respectively and continues to present hour.
- 2) Kilinochchi - Chunnakam cct 01 which tripped on 01.10.2022 was restored at 18:36hrs.
- 3) Kukule pond spilling continues to present hour.